# AL125220 Series

# Access Control Power Supply/Charger

# Models Include:

# AL125220

- Includes power supply, transformer, cam lock, and enclosure.
- 8.5" x 7.5" x 3.5" (215.9mm x 190.5mm x 88.9mm).
- Accommodates one (1) 12VDC/4AH battery.

### L125X220 Δ

- Includes power supply, transformer, cam lock, and enclosure.
- 13.5" x 13" x 3.25" (342.9mm x 330.2mm x 82.6mm).
- Accommodates up to two (2) 12VDC/7AH batteries.

# Installation Guide



More than just power.<sup>™</sup>

Rev. 102706

Installing Company: \_\_\_\_\_ Service Rep. Name: \_\_\_\_\_

Address:

Phone #:

### **Overview:**

Altronix AL125220 and AL125X220 Power Supply/Chargers convert 220VAC (working range 198VAC - 256VAC), 50/60Hz input into two individually PTC protected auto-resettable 12VDC or 24VDC outputs (see specifications). They are intended for use in Access Control applications and applications requiring an interface with Fire Alarm Control Panels.

# Specifications:

#### Input:

• 220VAC (working range 198VAC - 256VAC), 50/60 Hz, 0.3A.

#### Output:

- Two (2) 12VDC or 24VDC outputs.
- 1A total supply current @ 12VDC or 24VDC.
- Filtered and electronically regulated output.\*

#### **Battery Backup:**

- Built-in charger for sealed lead acid or gel type batteries.
- Maximum charge current: 400mA.
- Automatic switch over to stand-by battery when AC fails.

#### **Special Features:**

- AC power and unit status indicator on the front panel.
- Normally Open [NO] trigger input.
- Supervised Fire Alarm Disconnect (Latching w/reset or Non-Latching).

#### Enclosure Dimensions (H x W x D):

- AL125220: 8.5" x 7.5" x 3.5" (215.9mm x 190.5mm x 88.9mm). Accommodates one (1) 12VDC/4AH battery.
- AL125X220: 13.5" x 13" x 3.25" (342.9mm x 330.2mm x 82.6mm) Accommodates up to two (2) 12VDC/7AH batteries.
- \*Note: When unit is powered by battery back up (AC Fail condition), the voltage range is 9.3V-13.2V and 19.55V-26.4V for 12 and 24 volt operation respectively.

# Power Supply Output Specifications:

Output VDC	Switch Position	Max. Stand-by Load DC	Max. Alarm Load DC	Battery (optional)
12VDC	SW2 OFF	1A	1A	12VDC
24VDC	SW2 ON	1A	1A	24VDC

# **Stand-by Specifications:**

Output	4hr. of Stand-by & 5 min. of Alarm	Output	4hr. of Stand-by & 5 min. of Alarm
12VDC / 4AH Battery	0.5A / 1A	12VDC / 7AH Battery	1A / 1A
24VDC / 4AH Battery	0.5A / 1A	24VDC / 7AH Battery	1A / 1A

### **Installation Instructions:**

The units should be installed in accordance with article 760 of The National Electrical Code and NFPA 72 as well as all applicable Local Codes.

See Terminal Identification Chart on page 4 for a description of each terminal function.

- Mount unit in the desired location. Mark and predrill holes in the wall to line up with the top two keyholes in the enclosure. Install two upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the two upper screws; level and secure. Mark the position of the lower two holes. Remove the enclosure. Drill the lower holes and install two fasteners. Place the enclosure's upper keyholes over the two upper screws. Install the two lower screws and make sure to tighten all screws (Enclosure Dimensions, pgs. 7-8).
- Power connections: Connect secondary (blue and yellow leads) from the transformer to the Power Supply Board terminals marked [XFMR] (*Fig. 1 - Application Diagram, pg. 5*). Connect unswitched AC circuit (220VAC, 50/60Hz) as follows: Green branch wire (ground) connects to the terminal marked (), Line connects to the terminal marked [L], and Neutral connects to the terminal marked [N] of the Inlet Appliance Connector.

Use 18 AWG or larger for all power connections (Battery, AC input, DC outputs).

Use 22 AWG to 18 AWG for power-limited circuits (Trigger inputs, Dry outputs, DC outputs).

- 3. Measure output voltage before connecting devices. This helps avoiding potential damage.
- 4. Set the desired DC output voltage by setting switch SW2 to the appropriate position (*Power Supply Output Specifications Table, pg. 2, Fig. 1a, pg. 5*).
- 5. Connect Fail-Safe locking devices to the terminals marked [COM –] and [LOCK+].
- Connect Fail-Secure locking devices to the terminals marked [COM –] and [STRIKE +] (*Fig. 1, pg. 5*). 6. Connect normally open access control device (i.e. cardreader, request to exit device, access control system)
- to the terminals marked TRG INPUT [NO, GND] (*Fig. 1 Application Diagram, pg. 5*). 7. Connect FACP interface to the terminals marked [FACP1] and [FACP2]. Wire the 2.2K resistor (supplied) in series for a normally closed input or in parallel for a normally open input (*Fig. 1, pg. 5*). If required, set the latching FACP interface mode by turning SW1 ON (*Fig. 1, pg. 5*), and connect a normally open reset
- device to the terminals marked RESET [NO, GND].
  8. Connect battery to the terminals marked [+ BAT –] (battery leads included). Use two (2) 12VDC batteries connected in series for 24VDC operation. Note: For Access Control applications batteries are optional. When batteries are not used, a loss of AC will result in the loss of output voltage. When the use of stand-by batteries is desired, they must be lead acid or gel type.
  9. Please ensure that the cover is secured with the provided cam lock.

#### **Maintenance:**

Unit should be tested at least once a year for the proper operation as follows:

Output Voltage Test:	Under normal load conditions, the DC output voltage should be checked for proper
Battery Test:	voltage level ( <i>Power Supply Output Specifications Table, pg. 2</i> ). Under normal load conditions check that the battery is fully charged, check specified
Dattery Test.	voltage both at battery terminal and at the board terminals marked [+ BAT -] to
	ensure that there is no break in the battery connection wires.
Note:	Maximum charging current under discharge is 400mA.
Note:	Expected battery life is 5 years; however, it is recommended changing batteries in 4 years or less if needed.

# **Terminal Identification:**

Terminal Legend	Function/Description	
XFMR	Low voltage transformer connections.	
+ AUX -	Aux. power output terminals. These terminals supply 12VDC or 24VDC not affected by trig- ger, reset or fire alarm interface.	
LOCK + STRIKE + COM -	Switched power output. Fail-Safe [LOCK +] supplies positive power when unit is not trig- gered and FACP interface is inactive. Fail-Secure [STRIKE +] supplies positive power when unit is triggered and/or fire alarm interface is activated. [COM –] supplies negative power.	
FACP1 FACP2	Supervised by 2.2K end of line resistor FACP interface. Short or open will cause power to be dropped to terminal marked [LOCK +] and supply power to terminal marked [STRIKE +]. Condition can be maintained even after restoration of the circuit (latching mode).	
Trg input No, gnd	Short between these two terminals will cause power to be dropped to the terminal marked [LOCK+] and supplied to the terminal marked [STRIKE +].	
RESET NO, GND	Momentary short between these terminals would end latching FACP interface condition. Feature active only if latching FACP is selected (SW1 ON).	
+ BAT -	Stand-by battery connections.	

## **LED Diagnostics:**

Red	Power Supply Status	
ON	Normal function.	
OFF	No DC output.	
Slow Blink	Loss of AC.	
Rapid Blink	Unit is triggered, awaiting reset. Fire alarm interface activated.	



The lightning flash with arrowhead symbol within an equilateral triangle is intended to alert the user to the presence of an insulated DANGEROUS VOLTAGE within the product's enclosure that may be of sufficient magnitude to constitute an electric shock.



The exclamation point within an equilateral triangle is intended to alert the user to the presence of important operating and maintenance (servicing) instructions in the literature accompanying the appliance.



**CAUTION:** To reduce the risk of electric shock do not open enclosure. There are no user serviceable parts inside. Refer servicing to qualified service personnel.

### **Application Diagram:**


Fig. 1a SW2 0N SW2: **OFF-12VDC ON-24VDC** Ο  $\odot$ Transformer VR1 SW2: OFF-12VDC ON-24VDC E 0 5 XFMR ī BAT SW1 Stand-by **Batteries** NO GND NO GND TRIG INPUT RESET Ο FACP1 FACP2  $\bigcirc$ AUX COM - STRIKE+LOCK  $\oslash$ 00000  $\bigcirc$  $\bigcirc$  $( \land$ 00000 Normally MAG LOCK ELECTRIC Open STRIKE Access Card Reader Control Triggering NO Device FACP 2.2K EOL (supplied) Normally Open Reset ≶ Device Note: If 2.2K resistor is not installed unit will be in alarm condition. NC FACP


# **Notes:**

# Enclosure Dimensions (H x W x D):

AL125220


8.5" x 7.5" x 3.5" (215.9mm x 190.5mm x 88.9mm)




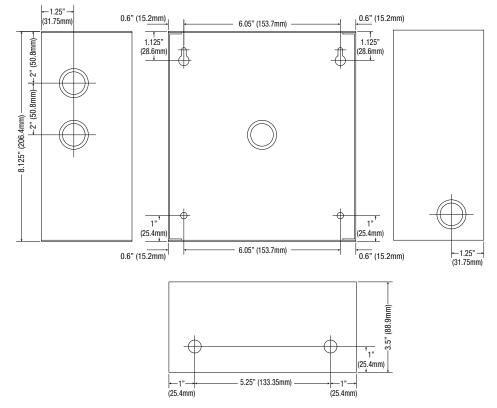

#### Enclosure Dimensions (H x W x D): AL125X220

13.5" x 13" x 3.25" (342.9mm x 330.2mm x 82.6mm)



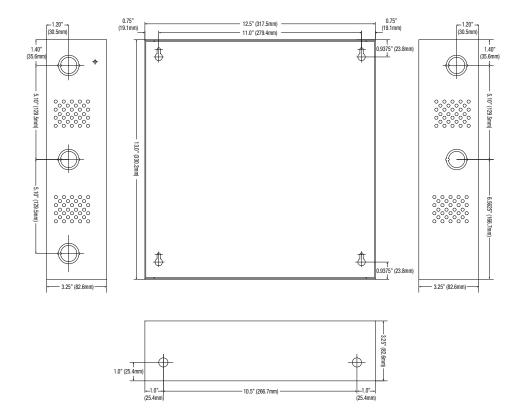

Altronix is not responsible for any typographical errors.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056 website: www.altronix.com | e-mail: info@altronix.com | Lifetime Warranty IIAL125220 Series F29U

