



Access & Power Integration

## Altronix/Kisi Kits

### Models Include:

#### T1KE34V

4 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove1 enclosure with TDR1 backplane
- One (1) AL600XB220 - Power Supply/Charger
- One (1) ACM4 - Fused Access Power Controller

#### T1KE38V

8 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove1 enclosure with TDR1 backplane
- One (1) AL600XB220 - Power Supply/Charger
- Two (2) ACM4 - Fused Access Power Controllers

#### T2KE3316V

16 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove2 enclosure with TDR2 backplane
- Two (2) AL600XB220 - Power Supply/Charger
- Two (2) ACM8 - Fused Access Power Controllers

#### T1KE34DV

4 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove1 enclosure with TDR1 backplane
- One (1) AL600XB220 - Power Supply/Charger
- One (1) ACM4CB - PTC Access Power Controller

#### T1KE38DV

8 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove1 enclosure with TDR1 backplane
- One (1) AL600XB220 - Power Supply/Charger
- Two (2) ACM4CB - PTC Access Power Controllers

#### T2KE3316DV

16 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove2 enclosure with TDR2 backplane
- Two (2) AL600XB220 - Power Supply/Charger
- Two (2) ACM8CB - PTC Access Power Controllers

Please refer to the included corresponding Sub-Assembly Installation Guides for further information.

## Installation Guide



All registered trademarks are property of their respective owners.



More than just power.™

Rev. 102924

Installing Company: \_\_\_\_\_ Service Rep. Name: \_\_\_\_\_

Address: \_\_\_\_\_ Phone #: \_\_\_\_\_

## Overview:

Altronix Trove Kisi kits are pre-assembled and consist of Trove1DR1 or Trove2DR2 enclosure/backplane with factory installed Altronix power supply/charger(s) and sub-assemblies. Trove Kisi kits also accommodates up to four (4) Kisi Pro Controllers for up to sixteen (16) doors in a single enclosure.

## Configuration Chart:


Altronix Model Number	220VAC 60Hz Input Current (A)	Power Supply Board Input Fuse Rating	Maximum Supply Current for Main Output on Power Supply board(s) and ACM4(CB)/ACM8(CB) Access Power Controllers' outputs	Nominal DC Output Voltage Range (VDC)	Fail-Safe/ Fail-Secure Outputs	ACM4(CB)/ ACM8(CB) Board Input Fuse (PTC) Rating	ACM4(CB)/ ACM8(CB) Board Output Fuse (PTC) Rating
T1KE34V	1.5	5A/ 250V	24VDC @ 5.7A	20.17-26.4	4	10A/32V	3A/32V
T1KE34DV						9A	2.5A
T1KE38V					8	10A/32V	3A/32V
T1KE38DV						9A	2.5A
T2KE3316V					16	10A/250V	3.5A/250V
T2KE3316DV							2.5A

## Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

1. Remove backplane from enclosure. Do not discard hardware.
2. Mark and predrill holes in the wall to line up with the top two/three keyholes in the enclosure. Install two/three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the two/three upper screws, level and secure. Mark the position of the lower two/three holes. Remove the enclosure. Drill the lower holes and install the two/three fasteners. Place the enclosure's upper keyholes over the two/three upper screws. Install the two/three lower screws and make sure to tighten all screws refer to *pages 6-7*.
3. Mount included UL Listed tamper switch (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure, approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
4. Mount Kisi Pro Controllers to TDR1 or TDR2 backplane, refer to *pages 3-5*.
5. Refer to the *XBV Power Supply/Charger Installation Guide* for AL600XB220 and corresponding *Sub-Assembly Installation Guides* for ACM4(CB) and ACM8(CB) for further installation instructions.

Fig. 1

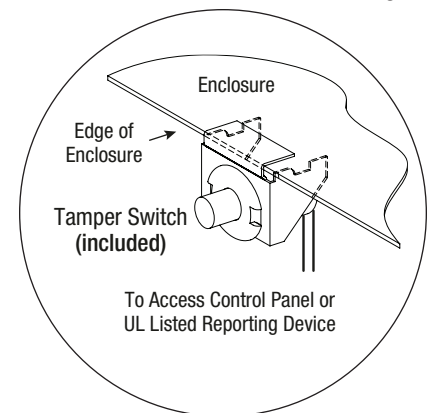

## Hardware:

	Spacer		5/16" Pan Head Screw		Mounting Magnet
--	--------	---	----------------------	---	-----------------

## T1KE34V and T1KE34DV: Configuration of Kisi Pro Controllers:

1. Fasten mounting magnets (provided) to Kisi Pro Controllers with screws and spacers (provided) using the controllers' mounting holes (Fig. 2, pg. 3).
2. Attach mounting magnets to TDR1 in the approximate position as shown below (Fig. 2a, pg. 3).  
**Note:** Kisi Pro Controllers should be properly oriented.  
Please make sure that they are mounted correctly, as shown in Fig. 2 below.
3. Fasten TDR1 backplane to Trove1 enclosure utilizing hardware (provided).

### Access Controller Position Chart for the Following Models:

Kisi	Pem Mounting
Pro Controller	(A)

Fig. 2 - T1KE34(D)V Configuration


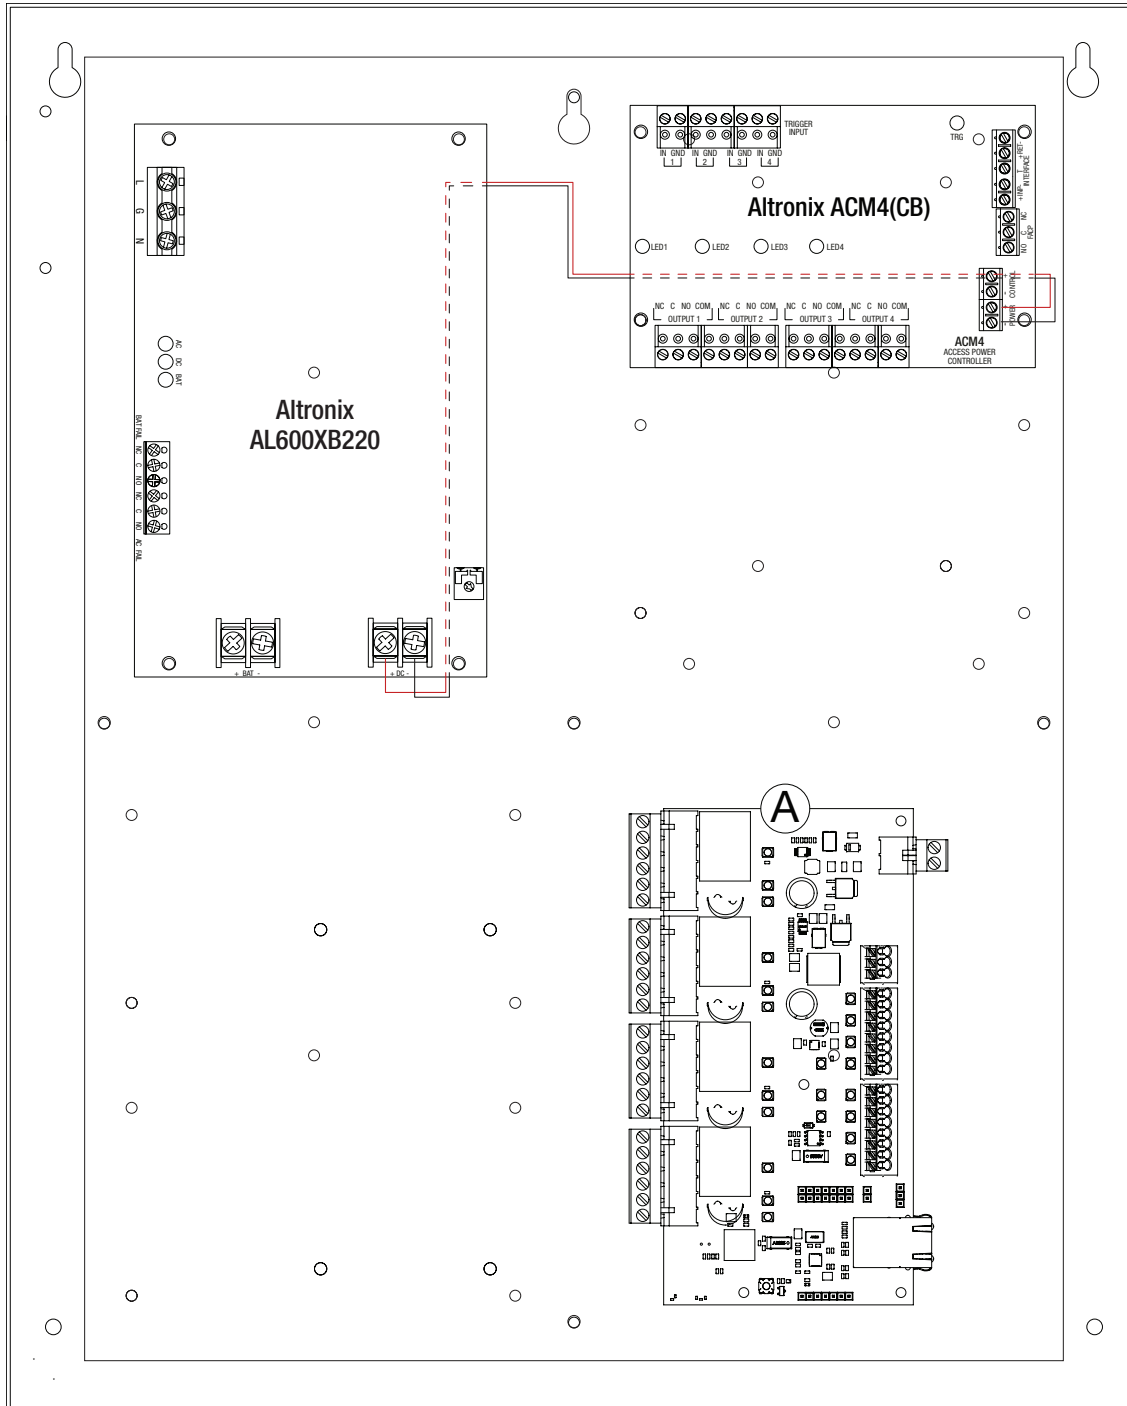


Fig. 2a

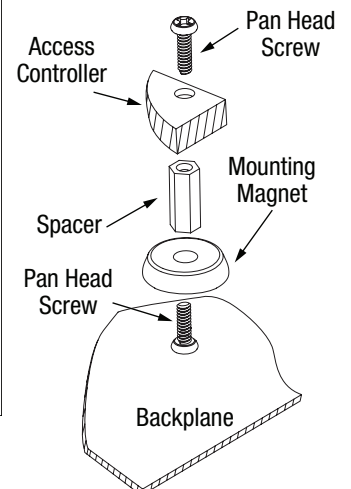

## T1KE38V and T1KE38DV: Configuration of Kisi Pro Controllers:

1. Fasten mounting magnets (provided) to Kisi Pro Controllers with screws and spacers (provided) using the controllers' mounting holes (Fig. 3, pg. 4).
2. Attach mounting magnets to TDR1 in the approximate position as shown below (Fig. 3a, pg. 4).  
**Note:** Kisi Pro Controllers should be properly oriented.  
Please make sure that they are mounted correctly, as shown in Fig. 3 below.
3. Fasten TDR1 backplane to Trove1 enclosure utilizing hardware (provided).

### Access Controller Position Chart for the Following Models:

Kisi	Pem Mounting
Pro Controller	(A)

Fig. 3 - T1KE38(D)V Configuration


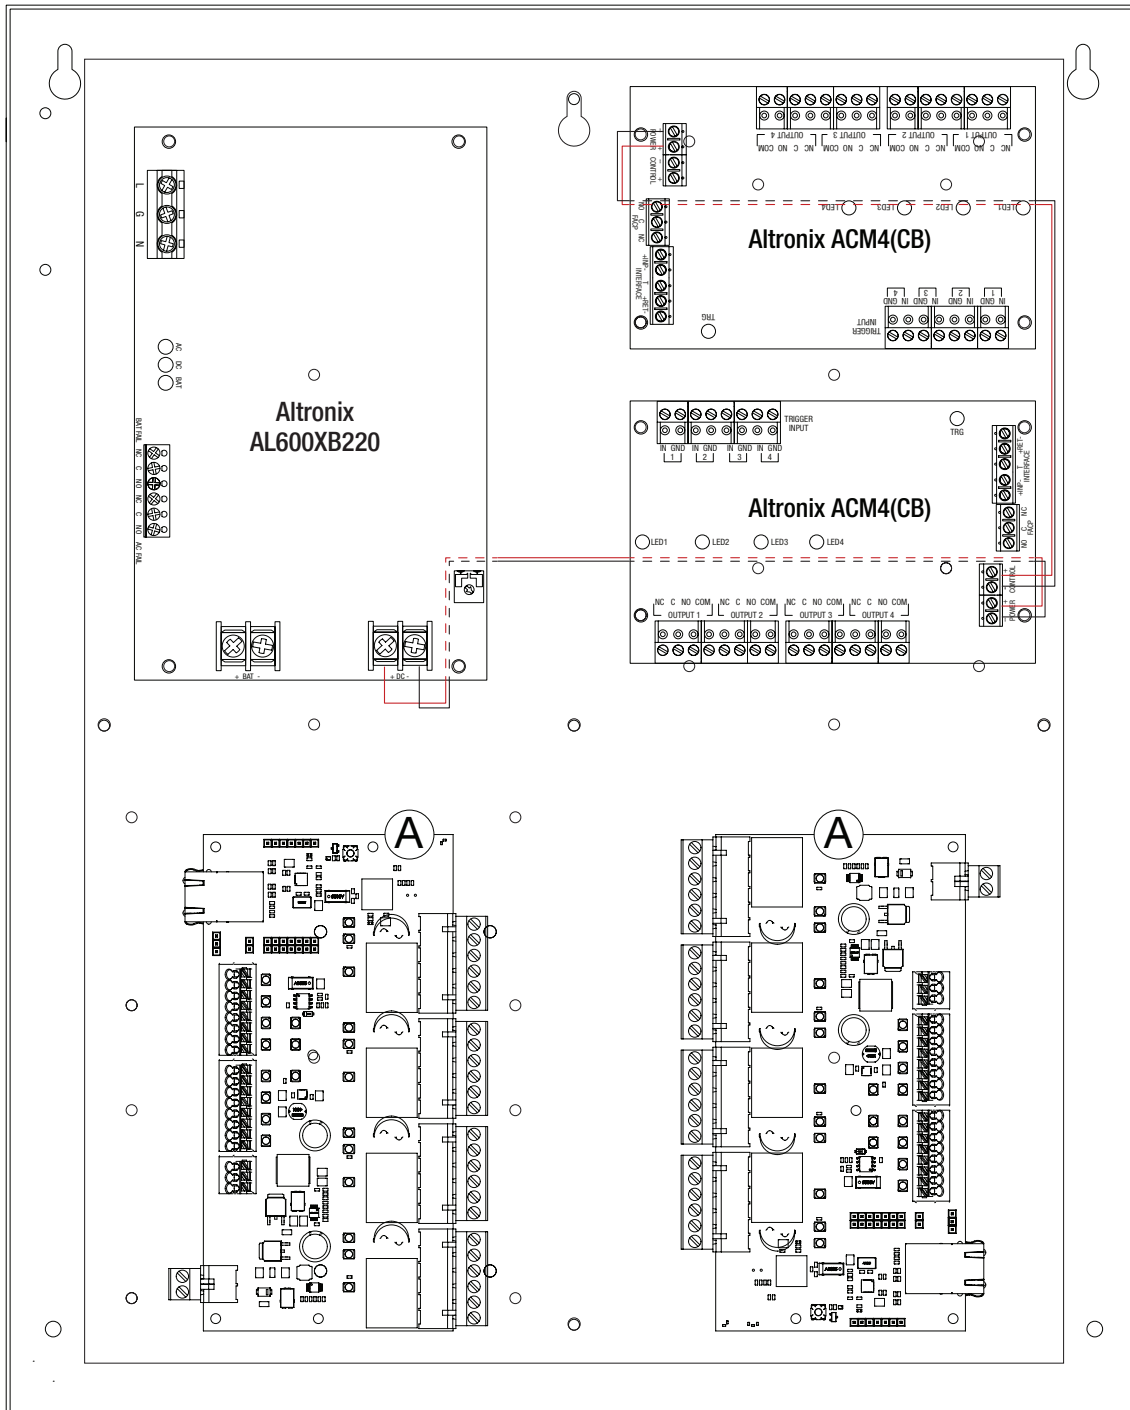


Fig. 3a

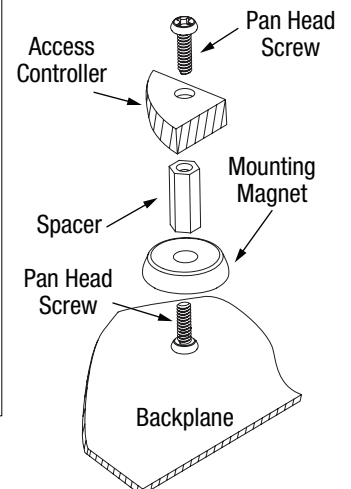

## T2KE3316V and T2KE3316DV: Configuration of Kisi Pro Controllers:

1. Fasten mounting magnets (provided) to Kisi Pro Controllers with screws and spacers (provided) using the controllers' mounting holes (*Fig. 4, pg. 5*).
2. Attach mounting magnets to TDR2 in the approximate position as shown below (*Fig. 4a, pg. 5*).  
**Note:** Kisi Pro Controllers should be properly oriented.  
Please make sure that they are mounted correctly, as shown in *Fig. 4* below.
3. Fasten TDR2 backplane to Trove2 enclosure utilizing hardware (provided).

### Access Controller Position Chart for the Following Models:

Kisi	Pem Mounting
Pro Controller	(A)

Fig. 4 - T2KE3316(D)V Configuration



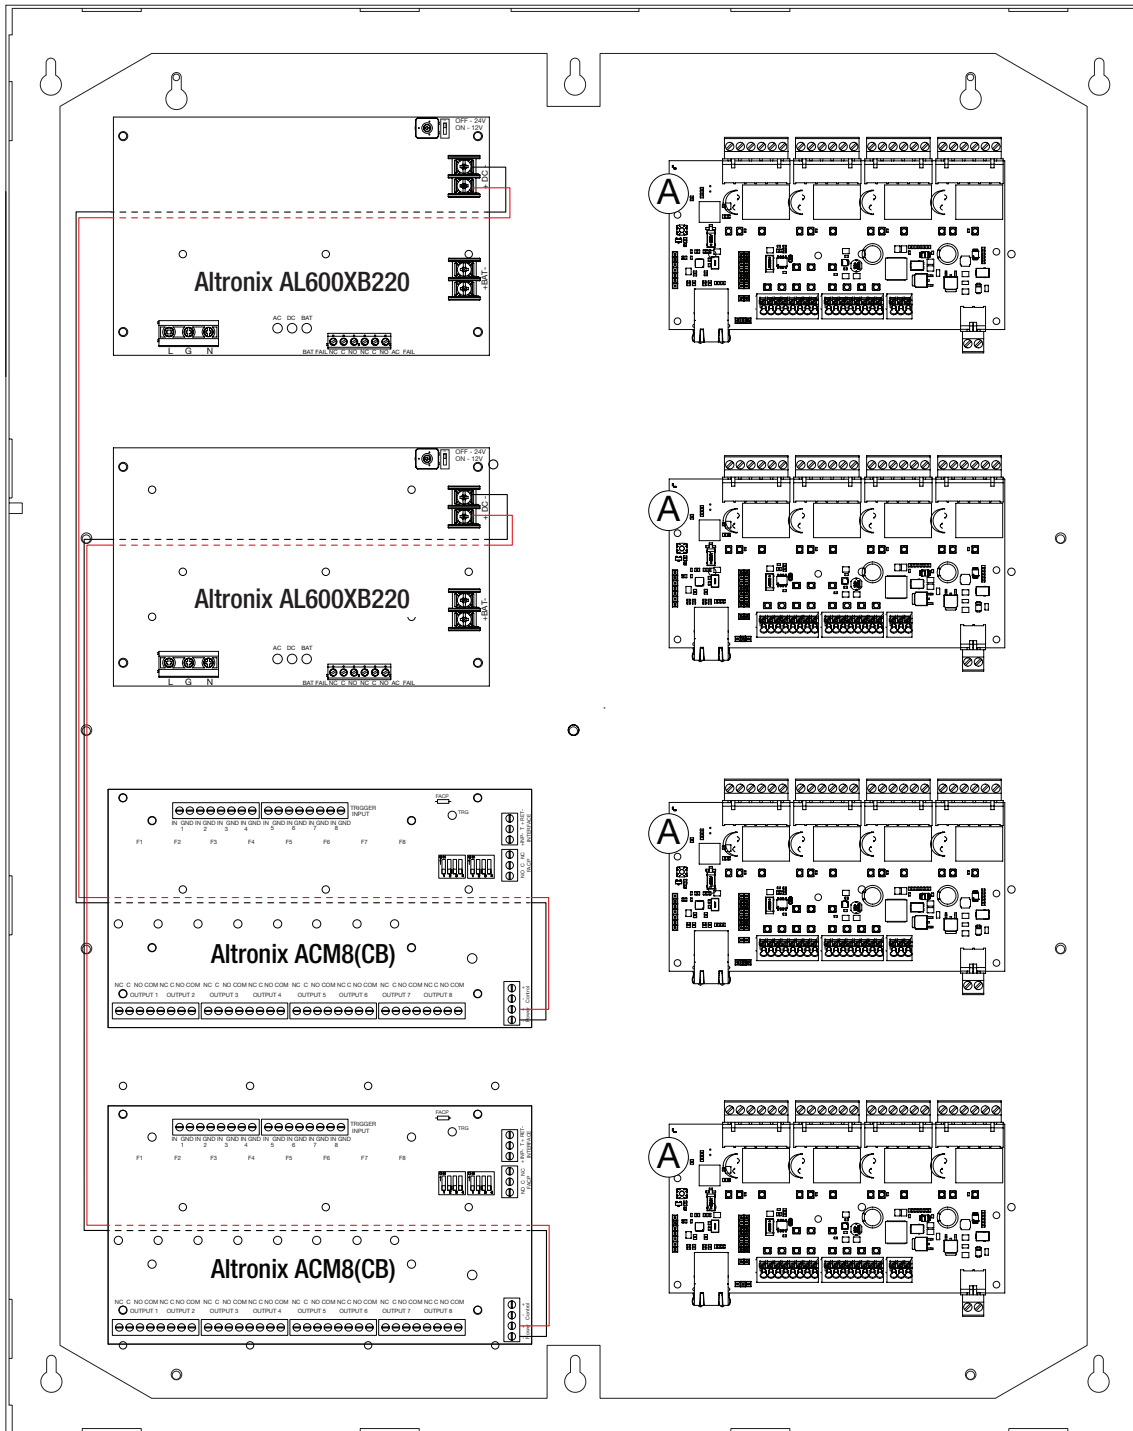


Fig. 4a

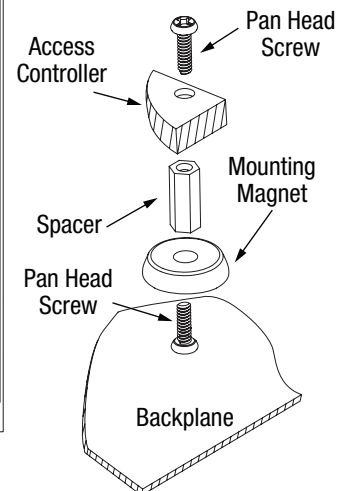


# T1KE34(D) and T1KE38(D) Enclosure Dimensions (H x W x D approximate):

18" x 14.5" x 4.625" (457mm x 368mm x 118mm)

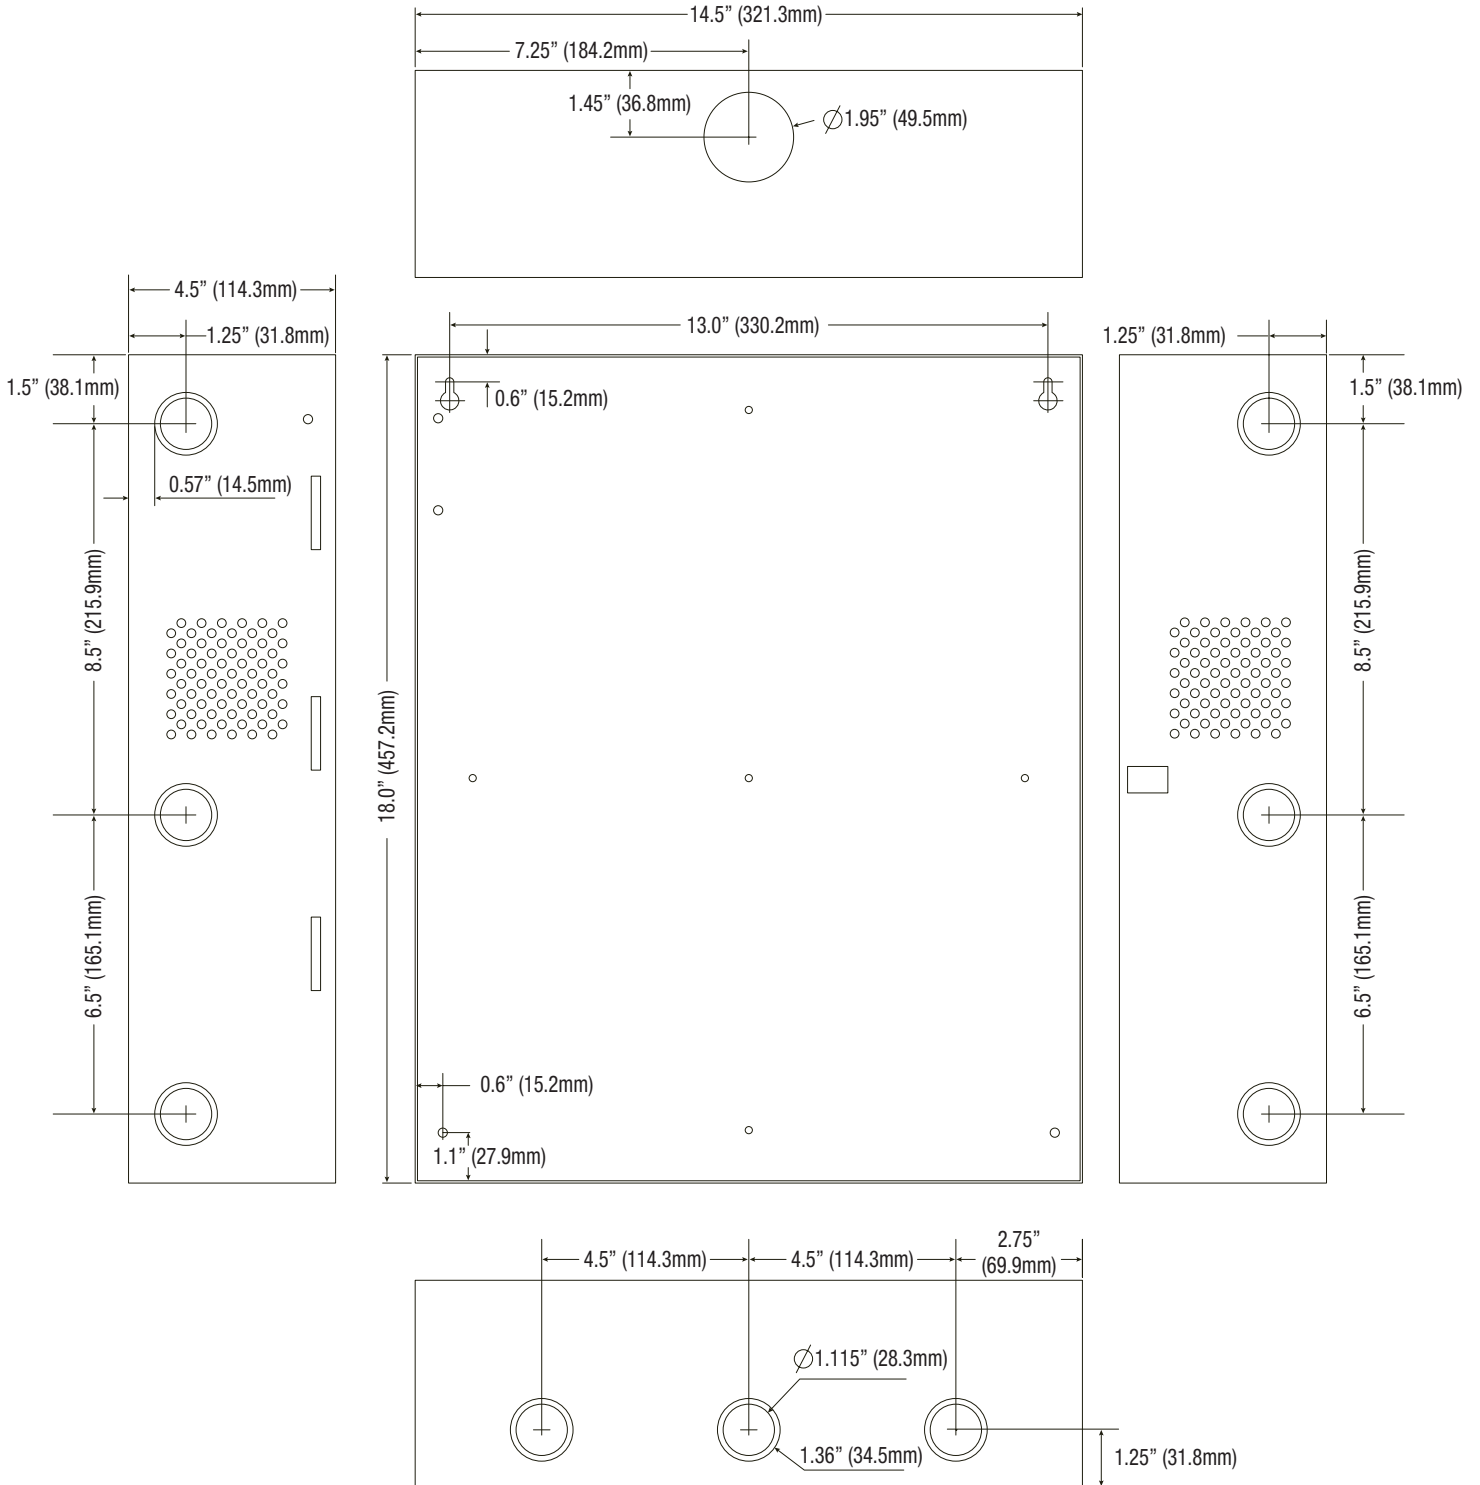

**T2KE3316(D) Enclosure Dimensions** (H x W x D approximate):

27.25" x 21.5" x 6.5" (692.2mm x 552.5mm x 165.1mm)

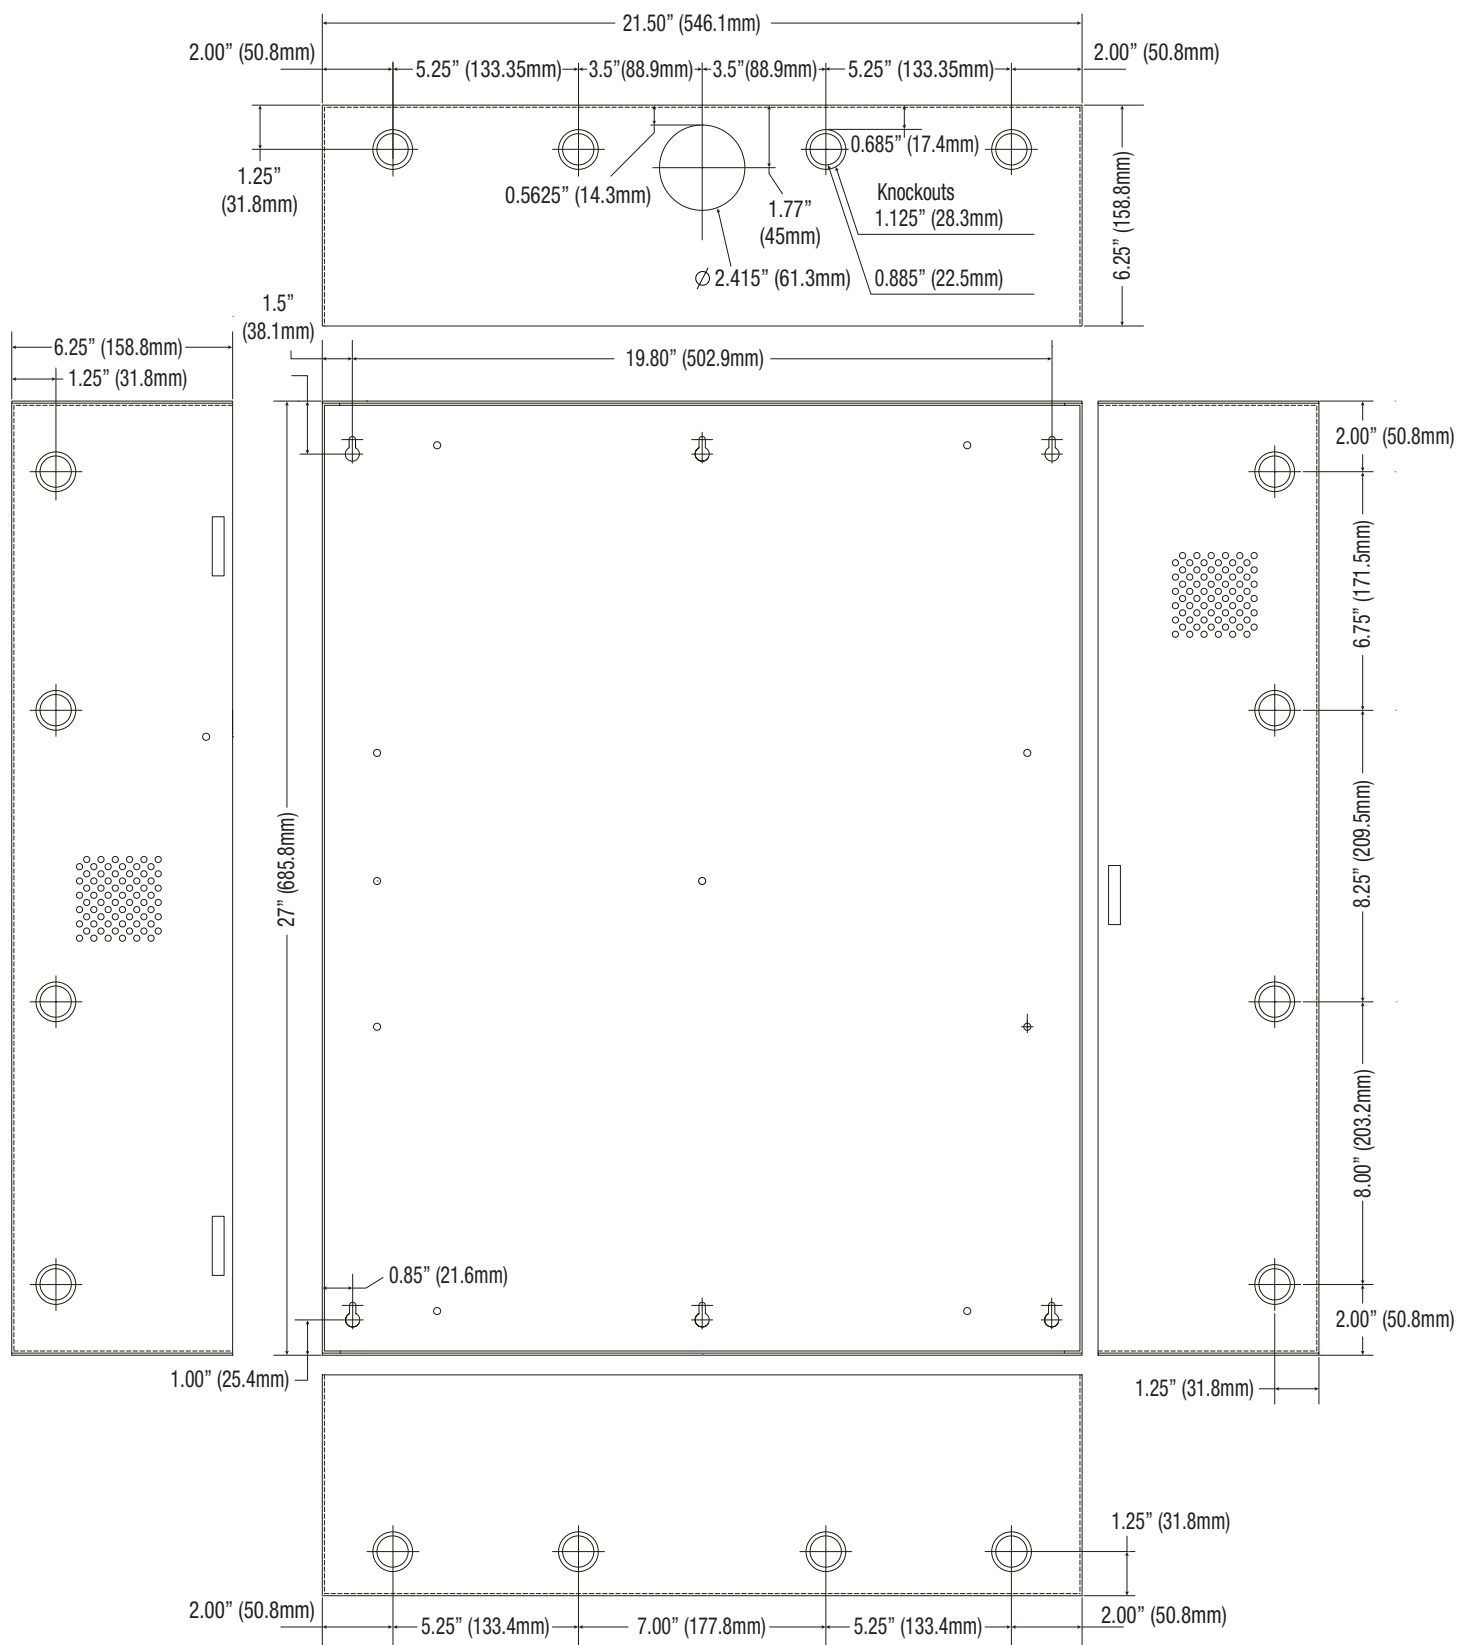

## Notes:

Altronix is not responsible for any typographical errors. Product specifications are subject to change without notice.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056  
website: [www.altronix.com](http://www.altronix.com) | e-mail: [info@altronix.com](mailto:info@altronix.com) | Lifetime Warranty  
II Trove KE XBV Kits

J29X

