



Access & Power Integration

## Altronix/Kantech Kits

### Models Include:

#### T2KHK3F12

12 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove2 enclosure with TKH2 Altronix/Kantech backplane
- One (1) eFlow6NB - Power Supply/Charger
- One (1) T1618300K - Transformer
- One (1) ACM4 - Fused Access Power Controller
- One (1) ACM8 - Fused Access Power Controller

#### T2KHK7F12

12 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove2 enclosure with TKH2 Altronix/Kantech backplane
- One (1) eFlow104NB - Power Supply/Charger
- One (1) ACM4 - Fused Access Power Controller
- One (1) ACM8 - Fused Access Power Controller

#### T2KHK3F12D

12 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove2 enclosure with TKH2 Altronix/Kantech backplane
- One (1) eFlow6NB - Power Supply/Charger
- One (1) T1618300K - Transformer
- One (1) ACM4CB - PTC Access Power Controller
- One (1) ACM8CB - PTC Access Power Controller

#### T2KHK7F12D

12 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove2 enclosure with TKH2 Altronix/Kantech backplane
- One (1) eFlow104NB - Power Supply/Charger
- One (1) ACM4CB - PTC Access Power Controller
- One (1) ACM8CB - PTC Access Power Controller

All components of these Trove kits are UL Listed sub-assemblies.

Please refer to the included corresponding Sub-Assembly Installation Guides for further information.

## Installation Guide



All registered trademarks are property of their respective owners.

Rev. 042924

Installing Company: \_\_\_\_\_ Service Rep. Name: \_\_\_\_\_

Address: \_\_\_\_\_ Phone #: \_\_\_\_\_



More than just power.™

## Overview:

Altronix Trove Kantech kits are pre-assembled and consist of Trove2KH2 enclosure/backplane with factory installed Altronix power supply/charger and sub-assemblies. These kits also accommodate various combinations of Kantech boards for up to twelve (12) doors in a single enclosure.

### TKH2 accommodates a combination of the following Kantech boards:

- Up to three (3) KT-MOD-INP16 or KT-MOD-OUTP16.
- Up to two (2) KT-1.
- Up to three (3) KT-400.

### Configuration Chart:

Altronix Model Number	Power Supply Board Input Fuse Rating	Power Supply Board Battery Fuse Rating	120VAC 60Hz Input Current (A)	Maximum Supply Current for Main and Aux. Outputs on Power Supply board and ACM4(CB)/ACM8(CB) Access Power Controllers' outputs	Nominal DC Output Voltage		Fail-Safe/Fail-Secure or Dry Form "C" Outputs	ACM4(CB) Board Input Fuse (PTC) Rating	ACM4(CB) Board Output Fuse (PTC) Rating	ACM8(CB) Board Input Fuse Rating	ACM8(CB) Board Output Fuse (PTC) Rating
					[DC]	[Aux]					
					Output Range (VDC)	Output Range (VDC)					
T2KHK3F12	5A/ 250V	10A/ 32V	3.5	24VDC @ 5.4A	20.17- 26.4	20.28- 26.4	12	10A/ 32V	3A/ 32V	10A/ 250V	3.5A/ 250V
T2KHK3F12D								9A	2.5A		2.5A
T2KHK7F12	6.3A/ 250V	15A/ 32V	4.5	24VDC @ 9.4A	20.17- 26.4	20.28- 26.4	12	10A/ 32V	3A/ 32V	10A/ 250V	3.5A/ 250V
T2KHK7F12D								9A	2.5A		2.5A

### Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

1. Remove backplane from enclosure. Do not discard hardware.
2. Mark and predrill holes in the wall to line up with the top three keyholes in the enclosure. Install three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the three upper screws, level and secure. Mark the position of the lower three holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the three upper screws. Install the three lower screws and make sure to tighten all screws.
3. Mount included UL Listed tamper switch (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
4. Mount Kantech boards to TKH2 backplane, refer to *page 3*.
5. Refer to the *eFlow Power Supply/Charger Installation Guide* for eFlow6NB and eFlow104NB and corresponding *Sub-Assembly Installation Guides* for the following models: ACM8(CB), ACM4(CB) and T1618300K for further installation instructions.

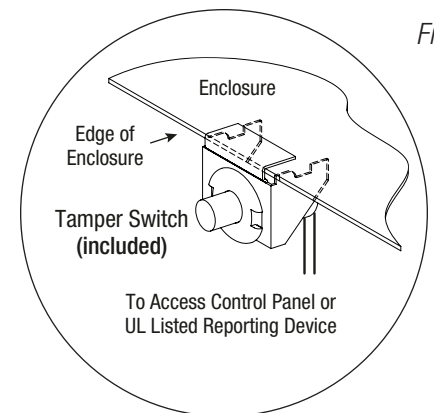


Fig. 1

## T2KHK3F12 and T2KHK3F12(D): Configuration of Kantech Boards:

1. Align Kantech boards on the backplane to match the boards' mounting holes with corresponding holes in backplane.
  - a. Position spacer over appropriate hole on the rear of backplane and depress it until it locks in place (*Fig. 2a, pg. 3, Step 1*).
  - b. Depress down on board to secure it to the spacer (*Fig. 2a, pg. 3, Step 2*).
2. Fasten backplane to Trove2 enclosure utilizing pan head screws (provided).

### Kantech Access Controller Position Chart for the Following Models:

Kantech Board	Pem Mounting
KT-400 Door Controller	(A)
KT-1 Door Controller	(B)
KT-MOD-INP16 or KT-MOD-OUTP16 Expansion Boards	(C)

Fig. 2


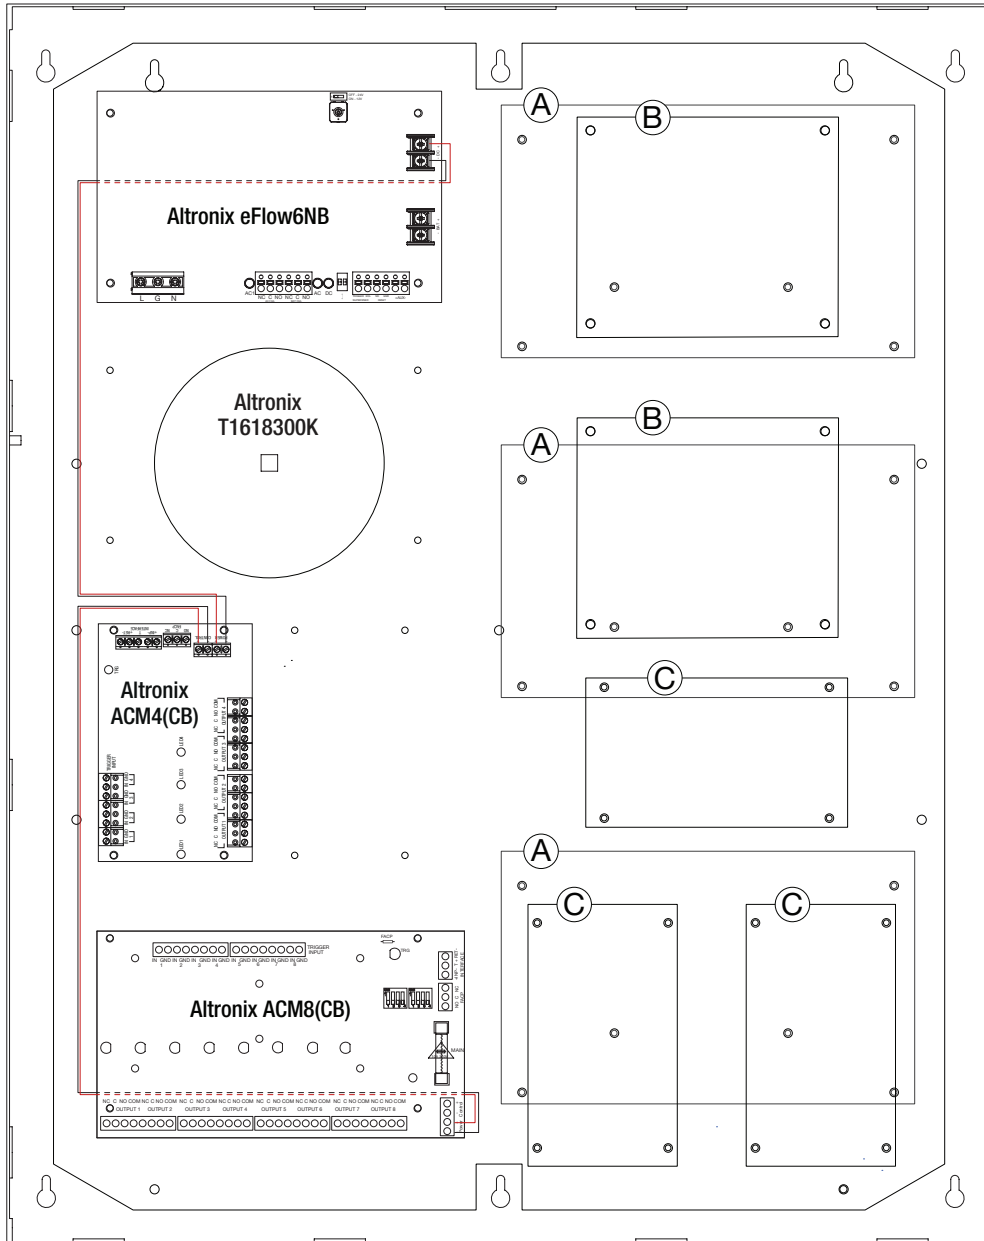


Fig. 2a

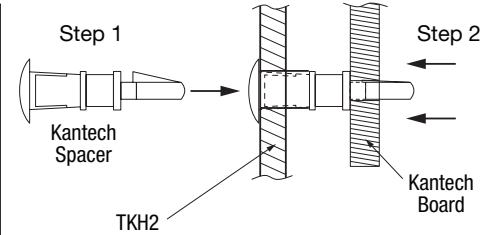

## T2KHK7F12 and T2KHK7F12(D): Configuration of Kantech Boards:

1. Align Kantech boards on the backplane to match the boards' mounting holes with corresponding holes in backplane.
  - a. Position spacer over appropriate hole on the rear of backplane and depress it until it locks in place (*Fig. 3a, pg. 4, Step 1*).
  - b. Depress down on board to secure it to the spacer (*Fig. 3a, pg. 4 Step 2*).
2. Fasten backplane to Trove2 enclosure utilizing pan head screws (provided).

### Kantech Access Controller Position Chart for the Following Models:

Kantech Board	Pem Mounting
KT-400 Door Controller	(A)
KT-1 Door Controller	(B)
KT-MOD-INP16 or KT-MOD-OUTP16 Expansion Boards	(C)

Fig. 3



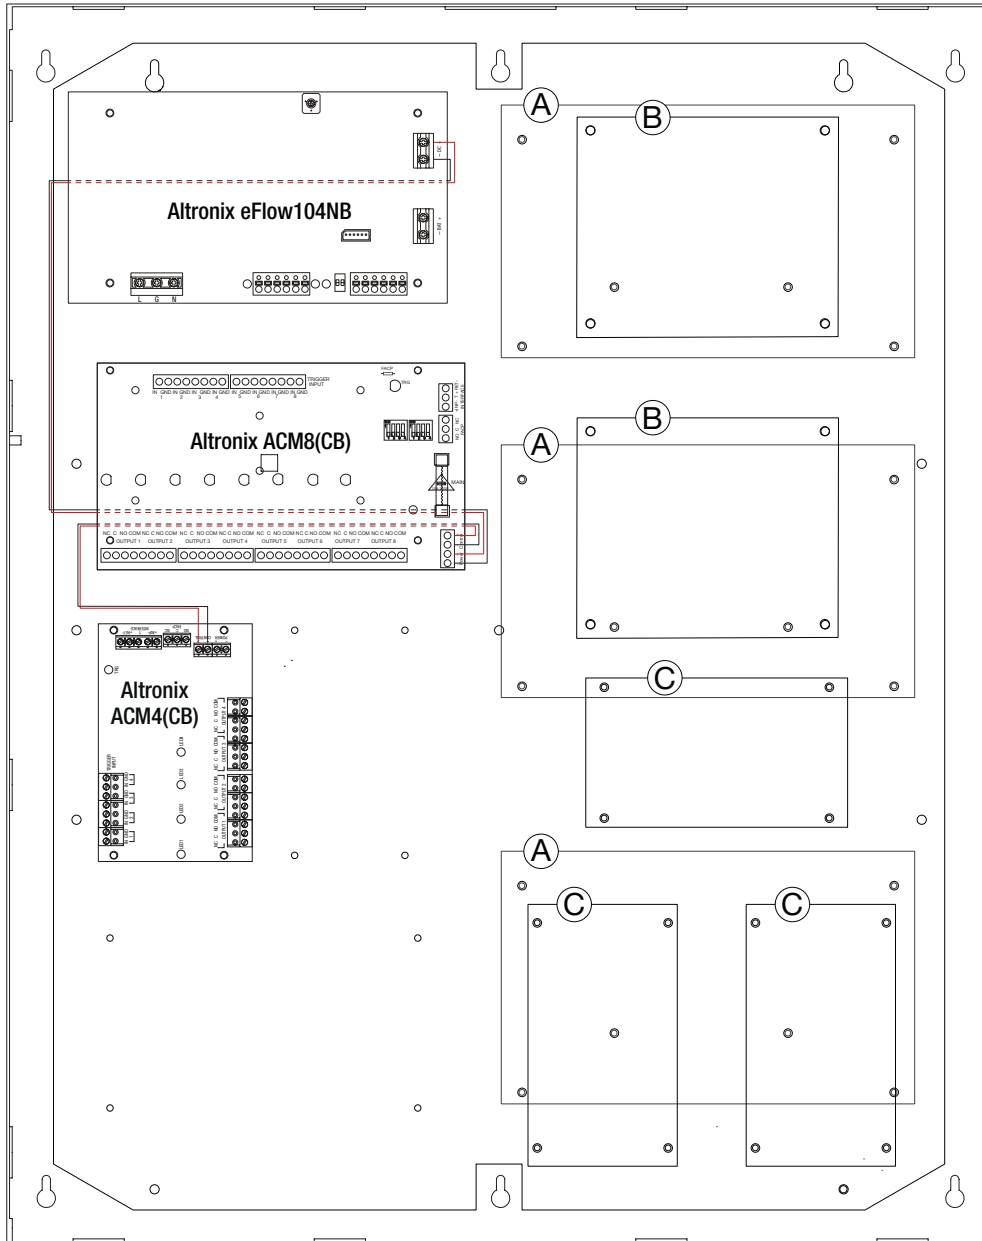


Fig. 3a



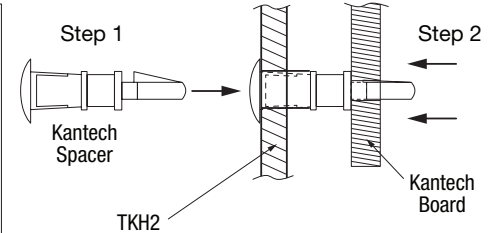

## eFlow Power Supply/Chargers can be Controlled and Monitored while Reporting Power/Diagnostics from Anywhere over the Network...

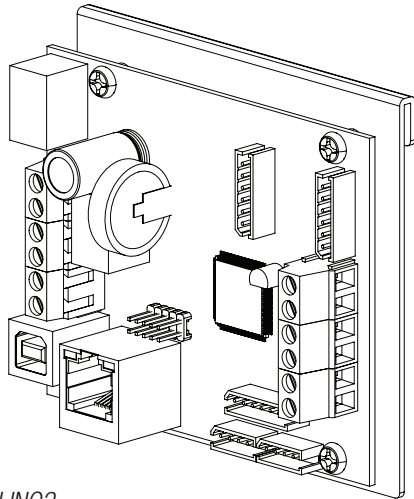

LINQ2

# LINQ™


### LINQ2 - Network Communication Module

LINQ2 provides remote IP access to real-time data from eFlow power supply/chargers to help keep systems up and running at optimal levels. It facilitates fast and easy installation and set-up, minimizes system downtime, and eliminates unnecessary service calls, which helps reduce Total Cost of Ownership (TCO) - as well as creating a new source of Recurring Monthly Revenue (RMR).

### Features:

- UL Listed in the U.S. and Canada.
- Local or remote control of up to (2) two Altronix eFlow power output(s) via LAN and/or WAN.
- Monitor real time diagnostics: DC output voltage, output current, AC & battery status/service, input trigger state change, output state change and unit temperature.
- Access control and user management: Restrict read/write, Restrict users to specific resources
- Two (2) integral network controlled Form "C" Relays.
- Three (3) programmable input triggers: Control relays and power supplies via external hardware sources.
- Email and Windows Dashboard notifications
- Event log tracks history.
- Secure Socket Layer (SSL).
- Programmable via USB or web browser - includes operating software and 6 ft. USB cable.


### LINQ2 Mounts Inside any Trove Enclosure

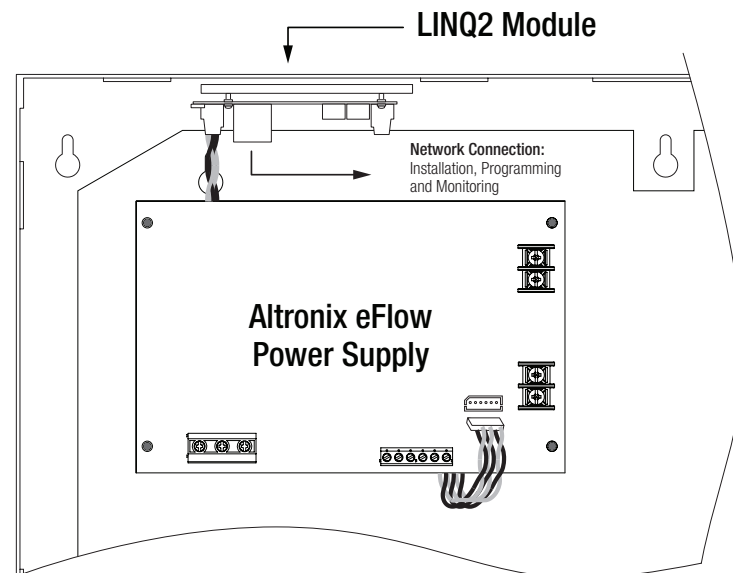

## Notes:

**Notes:**

**Enclosure Dimensions (H x W x D):**  
 27.25" x 21.75" x 6.5" (692.2mm x 552.5mm x 165.1mm)

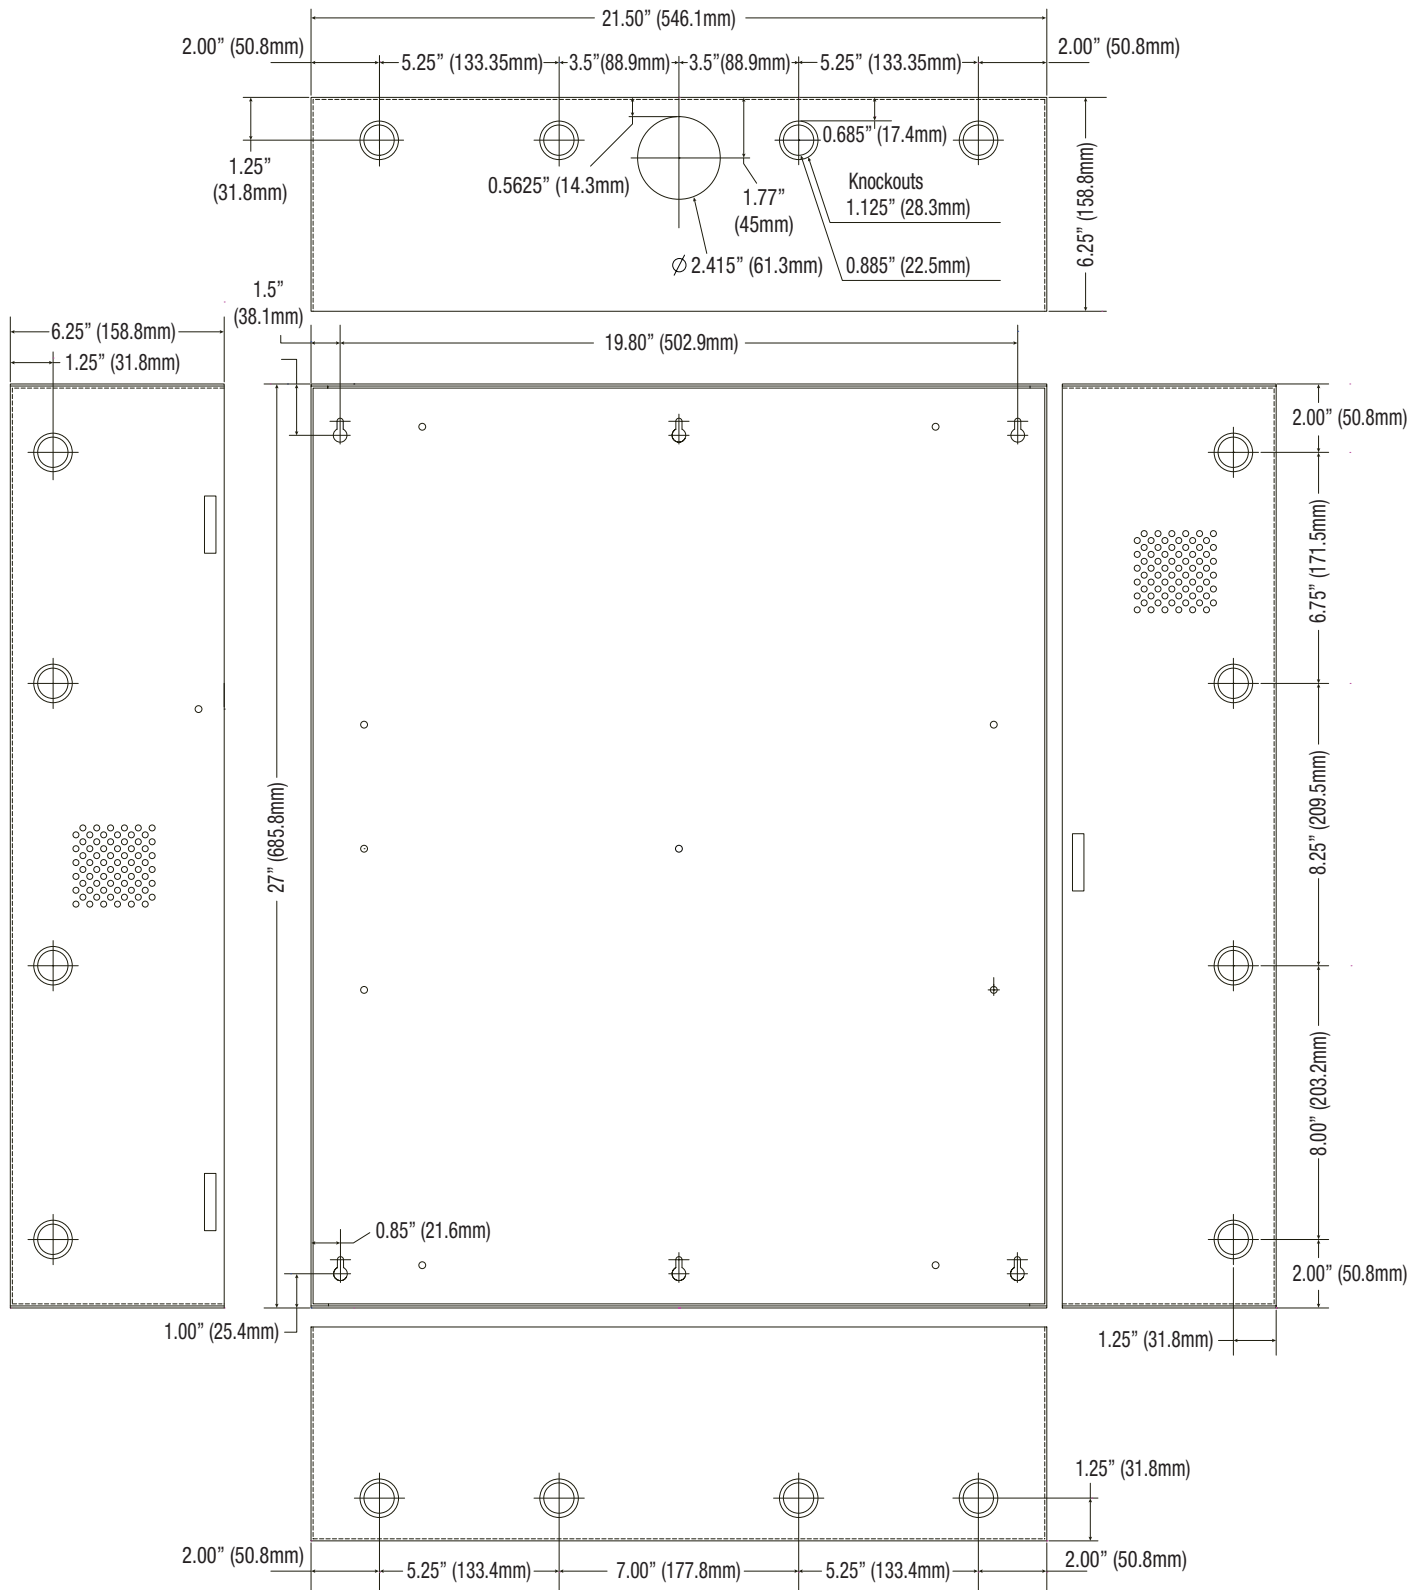

Altronix is not responsible for any typographical errors. Product specifications are subject to change without notice.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056  
 website: [www.altronix.com](http://www.altronix.com) | e-mail: [info@altronix.com](mailto:info@altronix.com) | Lifetime Warranty  
 IITroveKH Kits

D29X



TroveKH Kits Installation Guide