

Access & Power Integration

Altronix/Honeywell Wired Kits

Models Include:

T3HW75LXK1

16 Door Kit with Fused Outputs
Accommodates one (1) Intelligent Controller and seven (7) Dual Reader Modules.

T3HW75LXK3

16 Door Kit with Fused Outputs
Accommodates up to eight (8) Dual Reader Modules.

Each fully assembled kit includes:

- Trove3 enclosure with THW3 Altronix/Honeywell backplane and THWD2 Honeywell door backplane
- One (1) AL1024ULXB2 - Power Supply/Charger
- One (1) AL1012ULXB - Power Supply/Charger
- Two (2) ACMS8 - Dual Input/Output Fuse Protected Access Power Controllers
- Two (2) PDS8 - Dual Input/Output Fuse Protected Power Distribution Modules
- One (1) RSB2 - Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)
- Wire harnesses and finger duct

T3HW75LXK1D

16 Door Kit with PTC Outputs
Accommodates one (1) Intelligent Controller and seven (7) Dual Reader Modules.

T3HW75LXK3D

16 Door Kit with PTC Outputs
Accommodates up to eight (8) Dual Reader Modules.

Each fully assembled kit includes:

- Trove3 enclosure with THW3 Altronix/Honeywell backplane and THWD2 Honeywell door backplane
- One (1) AL1024ULXB2 - Power Supply/Charger
- One (1) AL1012ULXB - Power Supply/Charger
- Two (2) ACMS8CB - Dual Input/Output PTC Protected Access Power Controllers
- Two (2) PDS8CB - Dual Input/Output PTC Protected Power Distribution Modules
- One (1) RSB2 - Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)
- Wire harnesses and finger duct

Please refer to the included corresponding Sub-Assembly Installation Guides for further information.

Installation Guide



All registered trademarks are property of their respective owners.

Rev. T3HW75LXK_121922

Installing Company: _____ Service Rep. Name: _____

Address: _____ Phone #: _____



More than just power.™

Overview:

Altronix Trove Plus kits are pre-wired, pre-assembled and consist of Trove3HW3 enclosure/backplane with factory installed Altronix power supply/chargers and sub-assemblies, wire harnesses and finger duct.

Configuration Chart:

Altronix Model Number	115VAC 60Hz Input Current (A)	Power Supply Board Input Fuse Rating	Power Supply Board Battery Fuse Rating	Nominal DC Output Voltage Range		Maximum Supply Current for Main Outputs on Power Supply board and ACMS8(CB) Access Power Controller's outputs	Fail-Safe/Fail-Secure or Dry Form "C" Outputs	Current Per ACMS8(CB) and PDS8(CB) Output (A)	ACMS8(CB) Board Input Fuse (PTC) Rating	ACMS8(CB) Board Output Fuse (PTC) Rating	PDS8(CB) Board Input Fuse (PTC) Rating	PDS8(CB) Board Output Fuse (PTC) Rating
				Power Supply 1	Power Supply 2							
				Output Range (VDC)	Output Range (VDC)							
T3HW75LXK1	6.8	5A/250V	15A/32V	20.17-26.4	9.7-13.2	24VDC @ 9.4A	16	2.5	15A/32V	3A/32V	10A/32V	3A/32V
T3HW75LXK3												
T3HW75LXK1D												
T3HW75LXK3D												
								2.0	9A	2.5A	9A	2.5A

Hardware and Accessories:

- Two (2) tamper switches (Altronix Model TS112 or equivalent).
- Cam lock.
- Battery leads.

Mechanical:

- 16 Gauge enclosure with ample knockouts for convenient access.
- Enclosure Dimensions (H x W x D): 36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm).

Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.


1. Remove backplane from enclosure. Do not discard hardware.
2. Mark and predrill holes in the wall to line up with the top three keyholes in the enclosure. Install three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the three upper screws, level and secure. Mark the position of the lower three holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the three upper screws. Install the three lower screws and make sure to tighten all screws.
3. Mount included UL Listed tamper switches (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
4. Connect unswitched AC power (115VAC 60Hz) to RSB2. Use 14 AWG or larger for all power connections. Secure green wire lead to earth ground. Green "AC" LED on power supply board will turn on. This light can be seen through the LED lens on the door of the enclosure.

Keep power-limited wiring separate from non power-limited wiring (115VAC 60Hz Input, Battery Wires). Minimum 0.25" spacing must be provided.

CAUTION: Do not touch exposed metal parts. Shut branch circuit power before installing or servicing equipment. There are no user serviceable parts inside.

Refer installation and servicing to qualified service personnel.
5. Measure voltage before connecting devices. This helps avoiding potential damage.
6. Refer to the *ULXB Power Supply/Charger Installation Guide* for AL1024ULXB2 and AL1012ULXB and corresponding *Sub-Assembly Installation Guides* for PDS8(CB) and ACMS8(CB) for further installation instructions.
7. Position Honeywell access controller modules over corresponding spacers and depress onto snap on spacers (*Fig. 2-4, pg. 3-5*).
8. Connect wire harnesses to Honeywell access controller modules (*Fig. 2-4, pg. 3-5*).
9. Mount backplane to enclosure with hardware.

Fig. 1

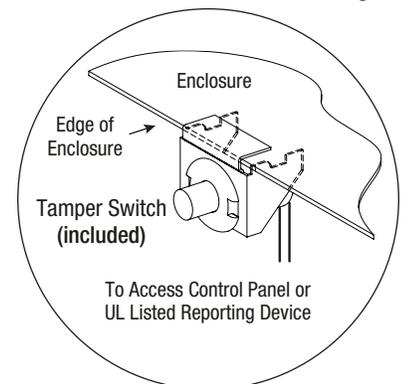


T3HW75LXK1(D) Configuration:

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 2, pg. 3).
2. Mount backplane to enclosure with hardware.

Access Controller Position Chart for the Following Models:

Honeywell Access Controller	Pem Mounting
PW7K11C / PRO421C	(A)
PW7K1R2 / PRO42R2	(B) (C) (D)

Fig. 2

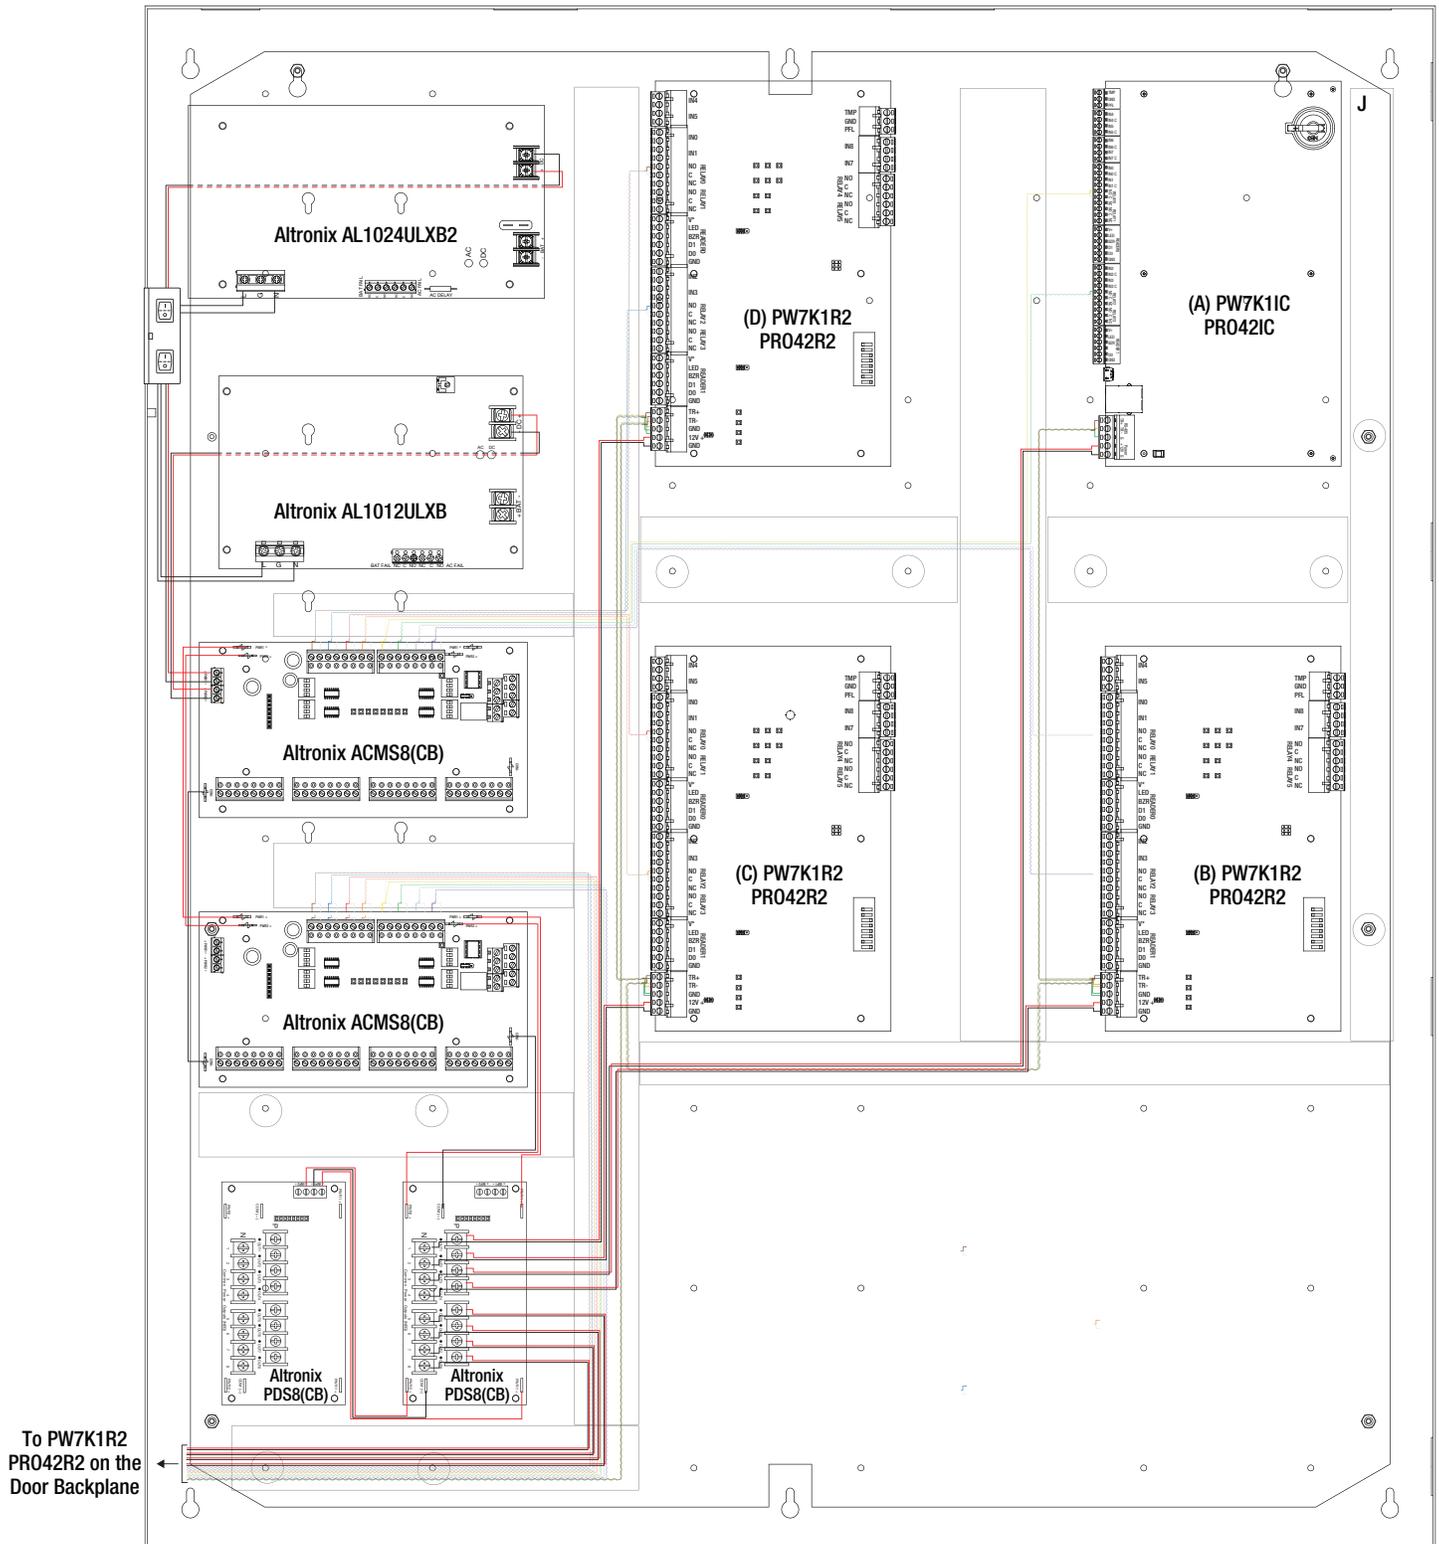


T3HW75LXK3(D) Configuration:

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 3, pg. 4).
2. Mount backplane to enclosure with hardware.

Access Controller Position Chart for the Following Models:

Honeywell Access Controller	Pem Mounting
PW7K1R2 / PRO42R2	A B C D

Fig. 3

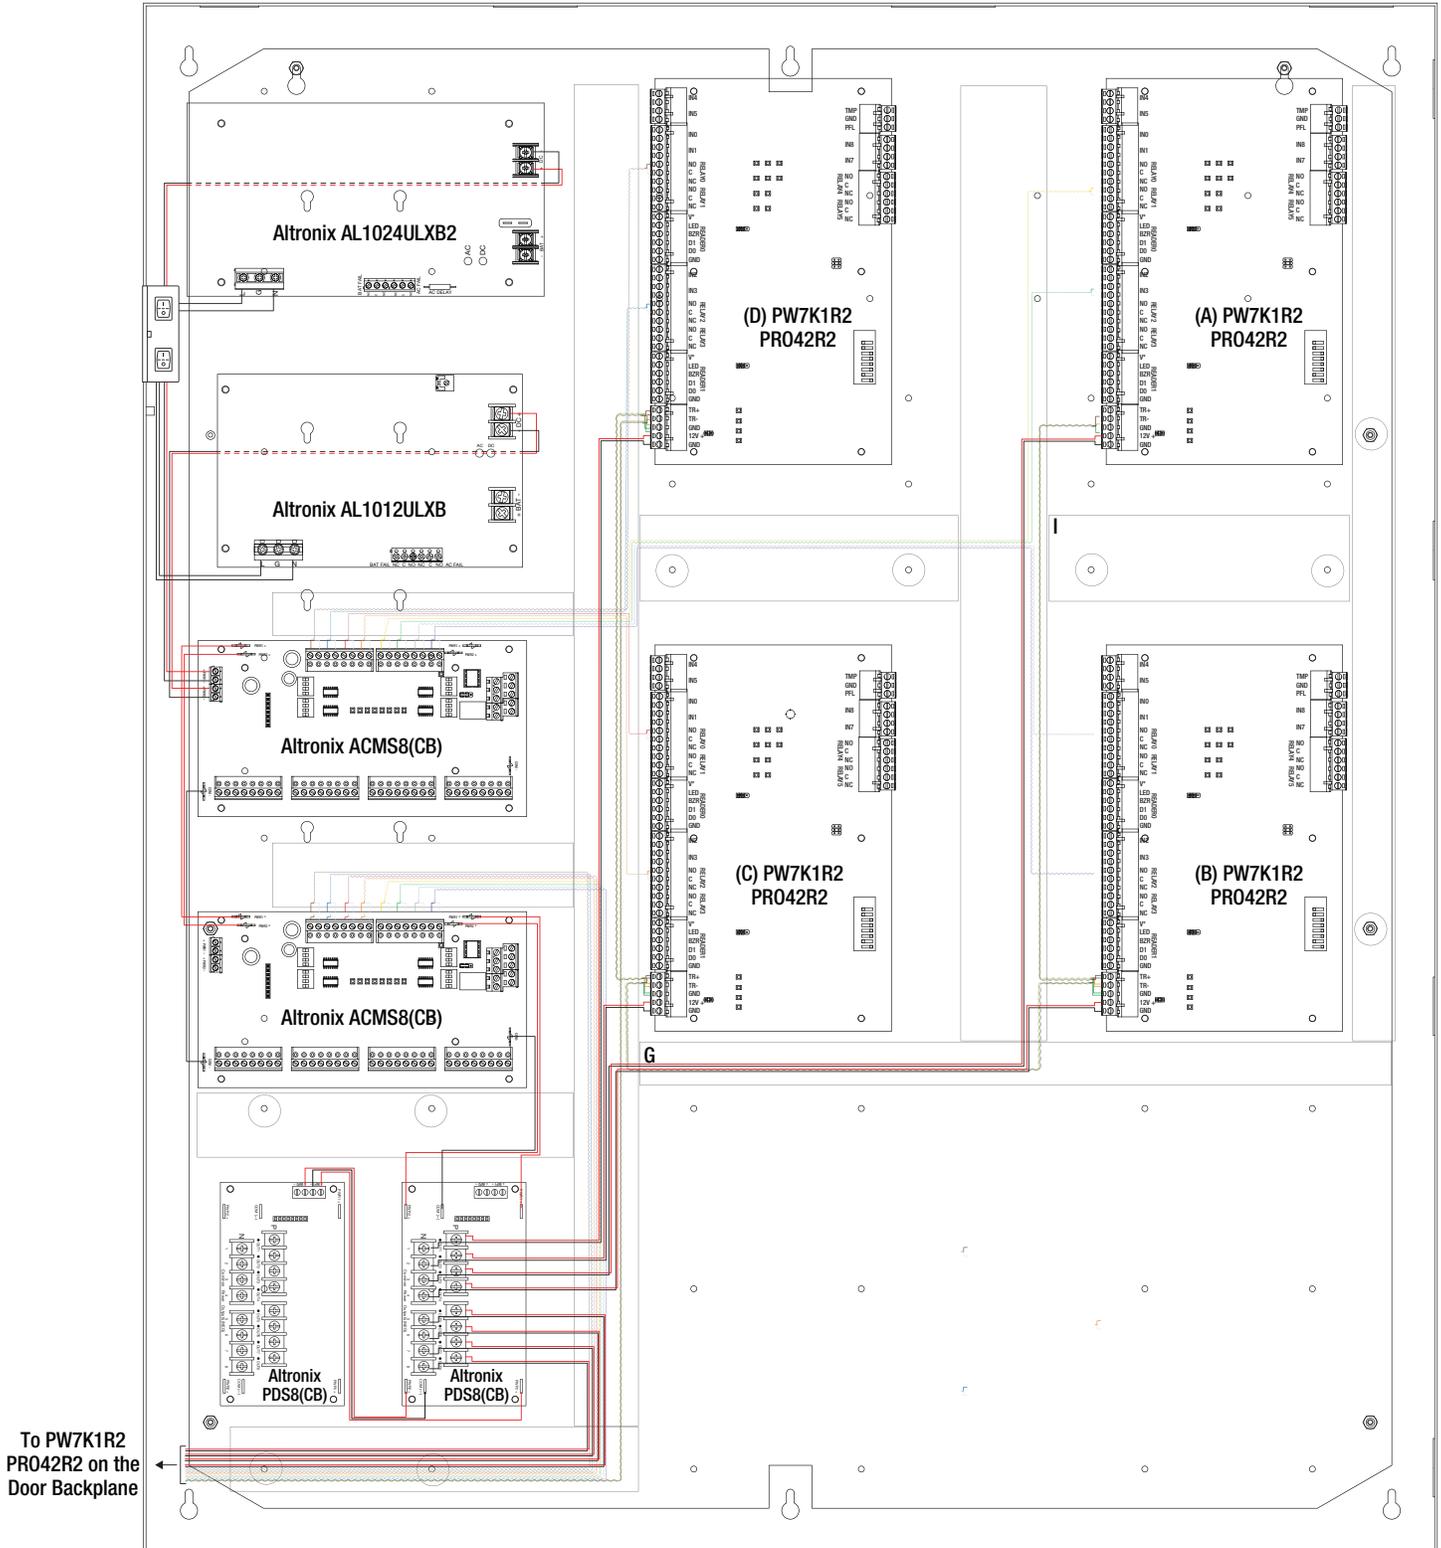


THWD2 (T3HW75LXK1(D) and T3HW75LXK3(D)) Configuration:

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 4, pg. 5).
2. Mount backplane to enclosure with hardware.

Access Controller Position Chart for the Following Models:

Honeywell Access Controller	Pem Mounting
PW7K1R2 / PRO42R2	(E) (F) (G) (H)


Fig. 4

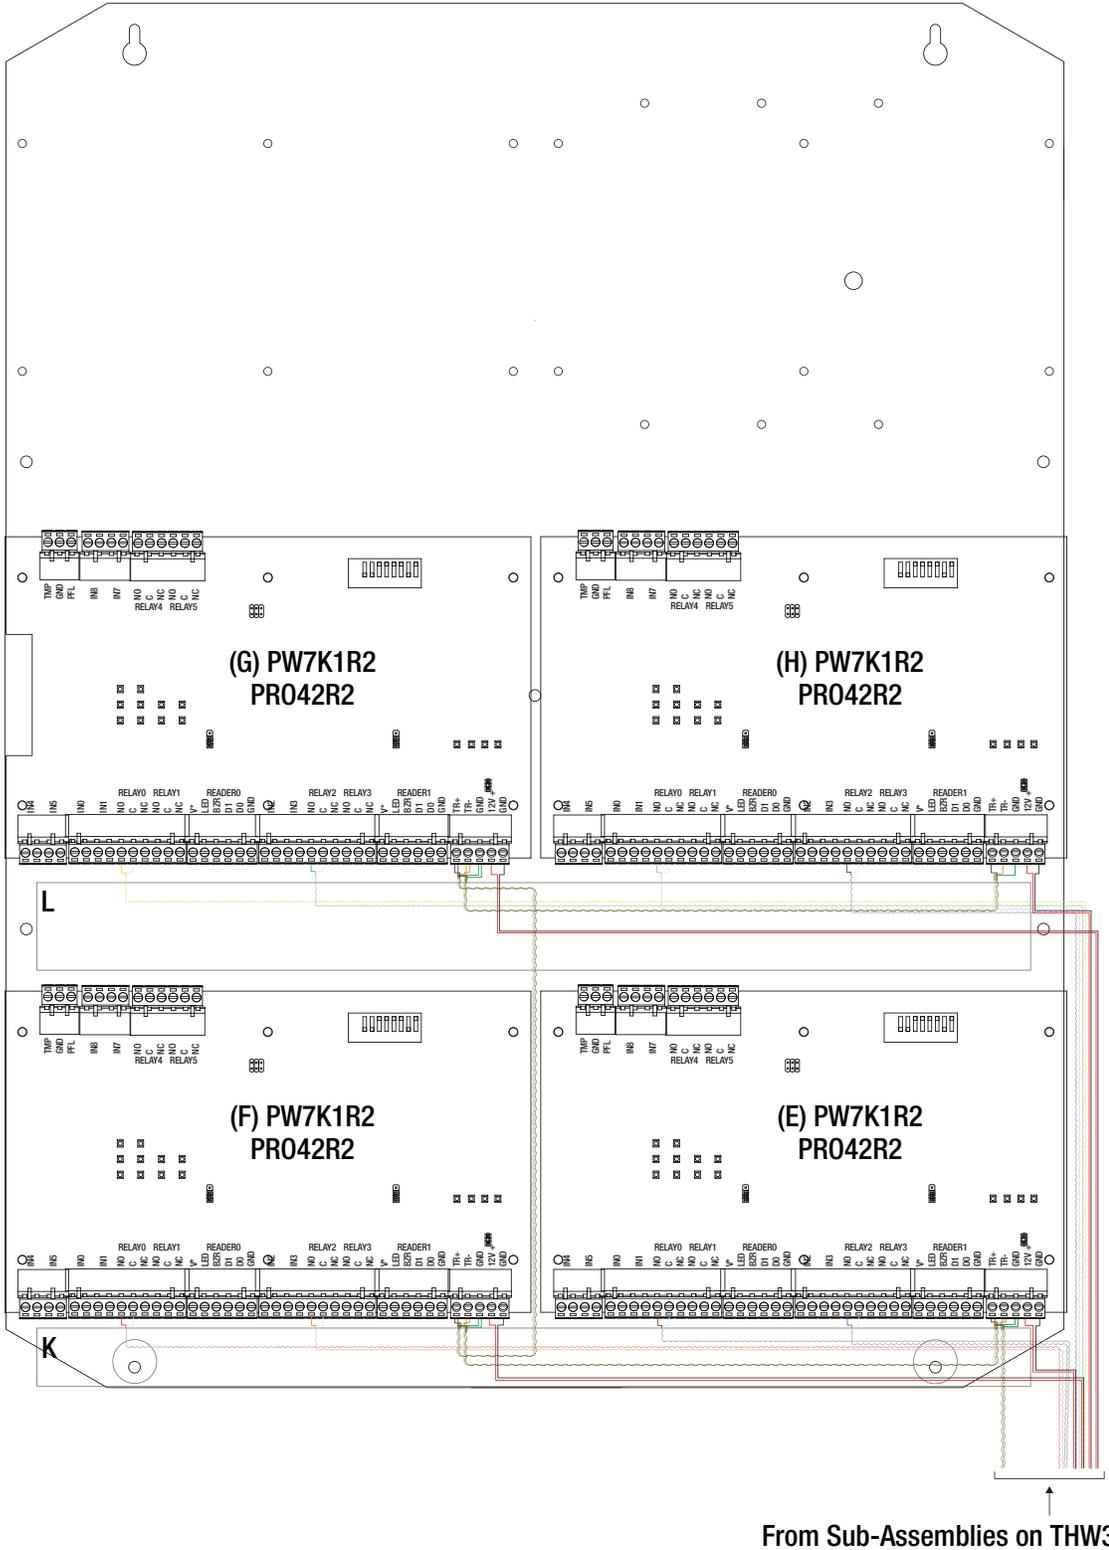

Notes:

Notes:

Trove3 Enclosure Dimensions (H x W x D approximate): 36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm)

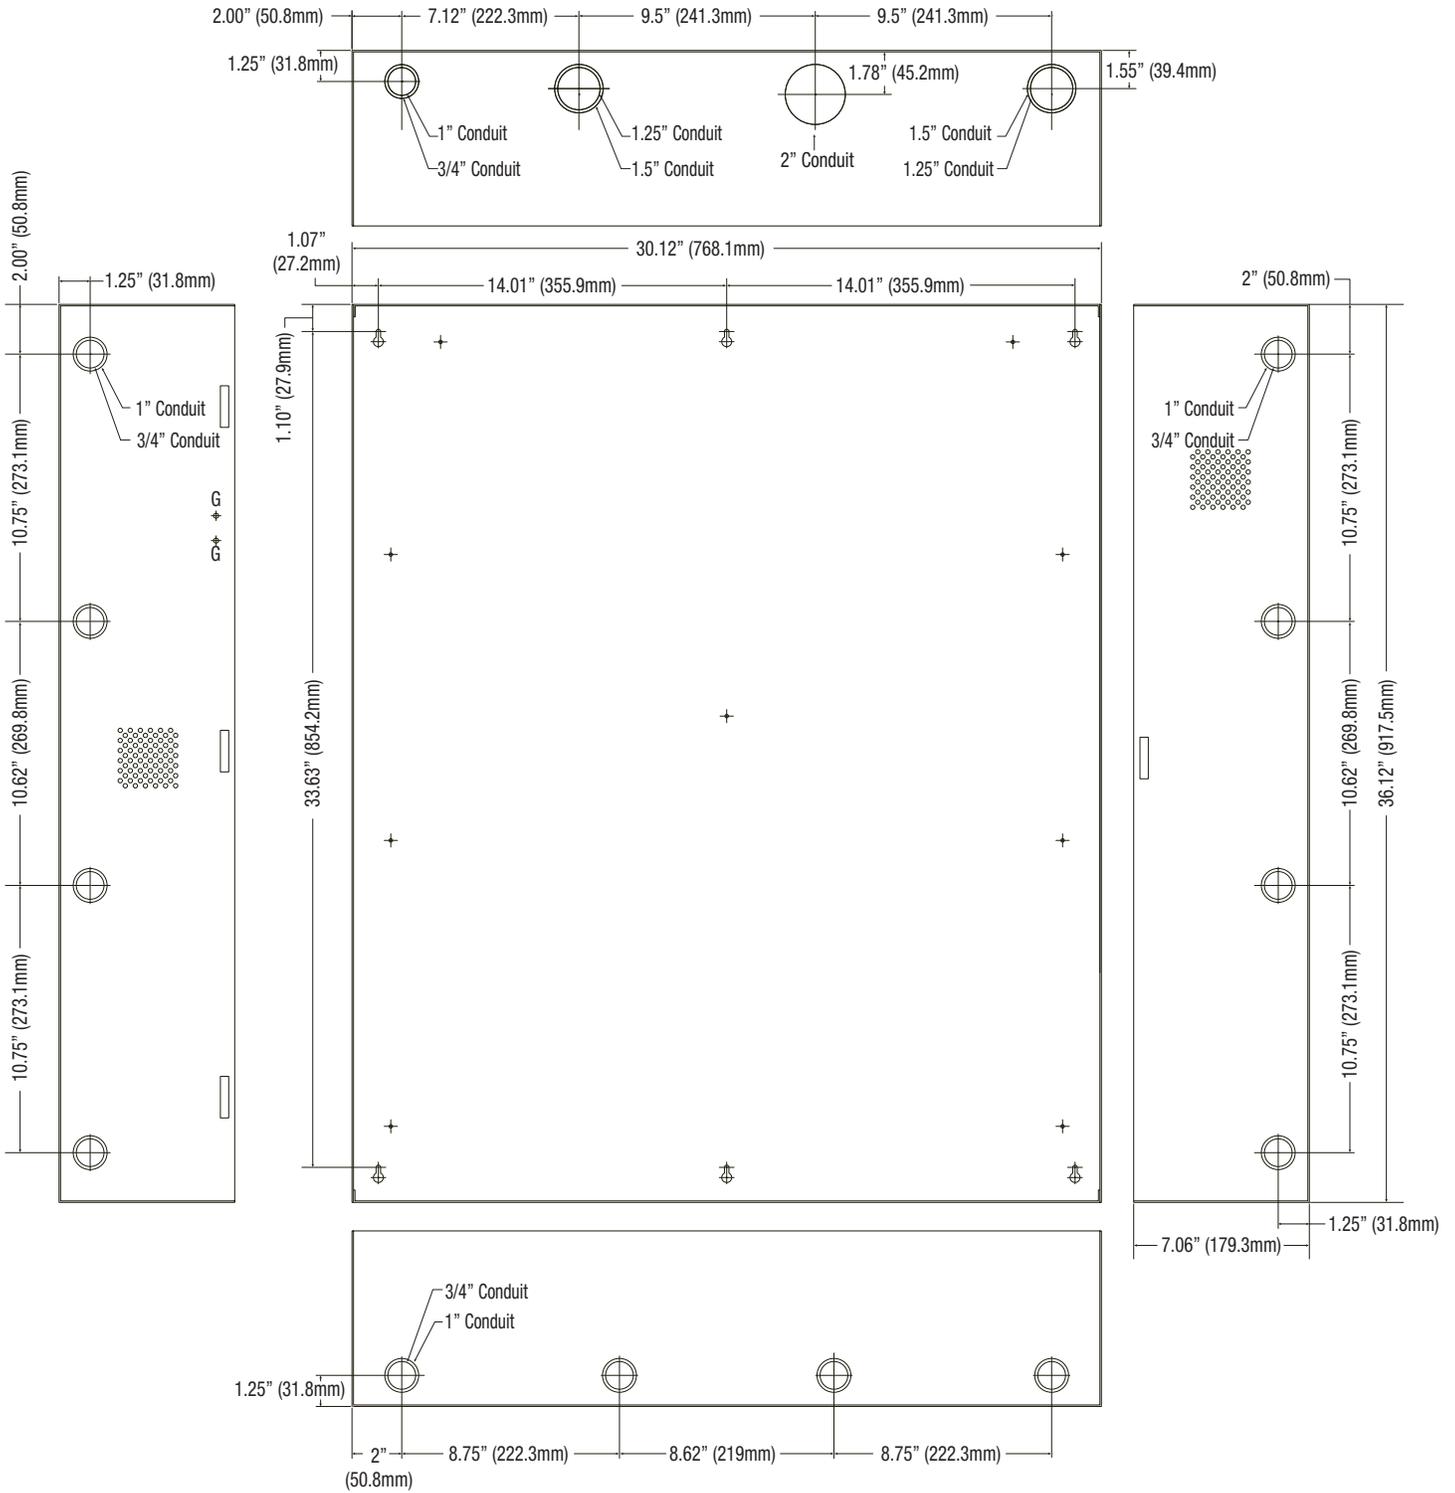

Altronix is not responsible for any typographical errors. Product specifications are subject to change without notice.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056
 website: www.altronix.com | e-mail: info@altronix.com | Lifetime Warranty
 IIT3HW75LXK Kit Series

L19V

