

Access & Power Integration

## Altronix/Mercury Wired Kits

### Models Include:

#### **T3M7724LXK1V**

##### **24 Door Kit with Fused Outputs**

Accommodates one (1) Intelligent Dual Reader Controller and eleven (11) Dual Reader Interface Modules.

##### **Fully assembled kit includes:**

- Trove3 enclosure with TM3 Altronix/Mercury backplane and TMV2 Mercury door backplane
- Two (2) AL1024XB2V - Power Supply/Chargers
- Two (2) ACMS12 - Dual Input/Output Fuse Protected Access Power Controllers
- Two (2) PDS16 - Dual Input/Output Fuse Protected Power Distribution Modules
- Two (2) VR6 - Voltage Regulators
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)
- Wire harnesses and finger duct

#### **T3M7724LXK1DV**

##### **24 Door Kit with PTC Outputs**

Accommodates one (1) Intelligent Dual Reader Controller and eleven (11) Dual Reader Interface Modules.

##### **Fully assembled kit includes:**

- Trove3 enclosure with TM3 Altronix/Mercury backplane and TMV2 Mercury door backplane
- Two (2) AL1024XB2V - Power Supply/Chargers
- Two (2) ACMS12CB - Dual Input/Output PTC Protected Access Power Controllers
- Two (2) PDS16CB - Dual Input/Output PTC Protected Power Distribution Modules
- Two (2) VR6 - Voltage Regulators
- One (1) Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)
- Wire harnesses and finger duct

## Installation Guide



All registered trademarks are property of their respective owners.

Rev. T3M7724LXKV\_122722

Installing Company: \_\_\_\_\_ Service Rep. Name: \_\_\_\_\_

Address: \_\_\_\_\_ Phone #: \_\_\_\_\_



**More than just power.™**

## Overview:

Altronix Trove Plus kits are pre-wired, pre-assembled and consist of Trove3M3 enclosure/backplane with factory installed Altronix power supply/chargers and sub-assemblies, wire harnesses and finger duct.

## Configuration Chart:

| Altronix Model Number | 220VAC 60Hz Input Current (A) | Power Supply Board Input Fuse Rating | Power Supply Board Battery Fuse Rating | Nominal DC Output Voltage Range |                    | Maximum Supply Current for Main Outputs on Power Supply board and ACMS12(CB) Access Power Controller's outputs | Fail-Safe/Fail-Secure or Dry Form "C" Outputs | Current Per ACMS12(CB) and PDS16(CB) Output (A) | ACMS12(CB) Board Input Fuse (PTC) Rating | ACMS12(CB) Board Output Fuse (PTC) Rating | PDS16(CB) Board Input Fuse (PTC) Rating | PDS16(CB) Board Output Fuse (PTC) Rating |
|-----------------------|-------------------------------|--------------------------------------|----------------------------------------|---------------------------------|--------------------|----------------------------------------------------------------------------------------------------------------|-----------------------------------------------|-------------------------------------------------|------------------------------------------|-------------------------------------------|-----------------------------------------|------------------------------------------|
|                       |                               |                                      |                                        | Power Supply 1                  | Power Supply 2     |                                                                                                                |                                               |                                                 |                                          |                                           |                                         |                                          |
|                       |                               |                                      |                                        | Output Range (VDC)              | Output Range (VDC) |                                                                                                                |                                               |                                                 |                                          |                                           |                                         |                                          |
| T3M7724LXK1V          | 5.0                           | 5A/ 250V                             | 15A/ 32V                               | 20.17- 26.4                     | 20.17- 26.4        | 24VDC @ 9.4A                                                                                                   | 24                                            | 2.5                                             | 15A/ 32V                                 | 3A/ 32V                                   | 15A/ 32V                                | 3A/ 32V                                  |
| T3M7724LXK1DV         |                               |                                      |                                        |                                 |                    |                                                                                                                |                                               | 2.0                                             | 9A                                       | 2.5A                                      | 9A                                      | 2.5A                                     |

## Hardware and Accessories:

- Two (2) tamper switches (Altronix Model TS112 or equivalent).
- Cam lock.
- Battery leads.


## Mechanical:

- 16 Gauge enclosure with ample knockouts for convenient access.
- Enclosure Dimensions (H x W x D): 36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm).

## Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

1. Remove backplane from enclosure. Do not discard hardware.
2. Mark and predrill holes in the wall to line up with the top three keyholes in the enclosure. Install three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the three upper screws, level and secure. Mark the position of the lower three holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the three upper screws. Install the three lower screws and make sure to tighten all screws.
3. Mount included UL Listed tamper switches (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
4. Refer to the *XBV Power Supply/Charger Installation Guide* for AL1024XB2V and corresponding *Sub-Assembly Installation Guides* for PDS16(CB) and ACMS12(CB) for further installation instructions.
5. Position Lenel/Mercury access controller modules over corresponding spacers and depress onto snap on spacers (*Fig. 2-4, pg. 3-5*).
6. Connect wire harnesses to Lenel/Mercury access controller modules (*Fig. 2-3, pg. 3-4*).
7. Mount backplane to enclosure with hardware.

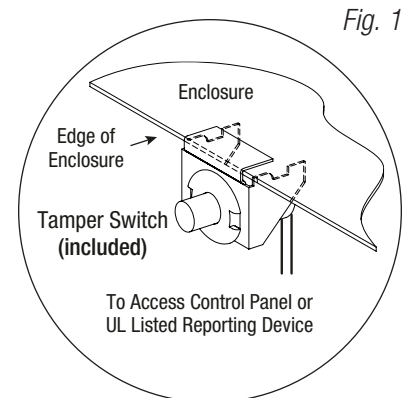


## T3M7724LXK1(D)V Configuration:

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 2, pg. 3).
2. Mount backplane to enclosure with hardware.

### Access Controller Position Chart for the Following Models:

| LenelS2 / Mercury Access Controller | Pem Mounting                |
|-------------------------------------|-----------------------------|
| LNL-2220 / LP1502                   | (E)                         |
| LNL-1320-S3 / MR52                  | (A) (B) (C) (D) (F) (G) (H) |

Fig. 2

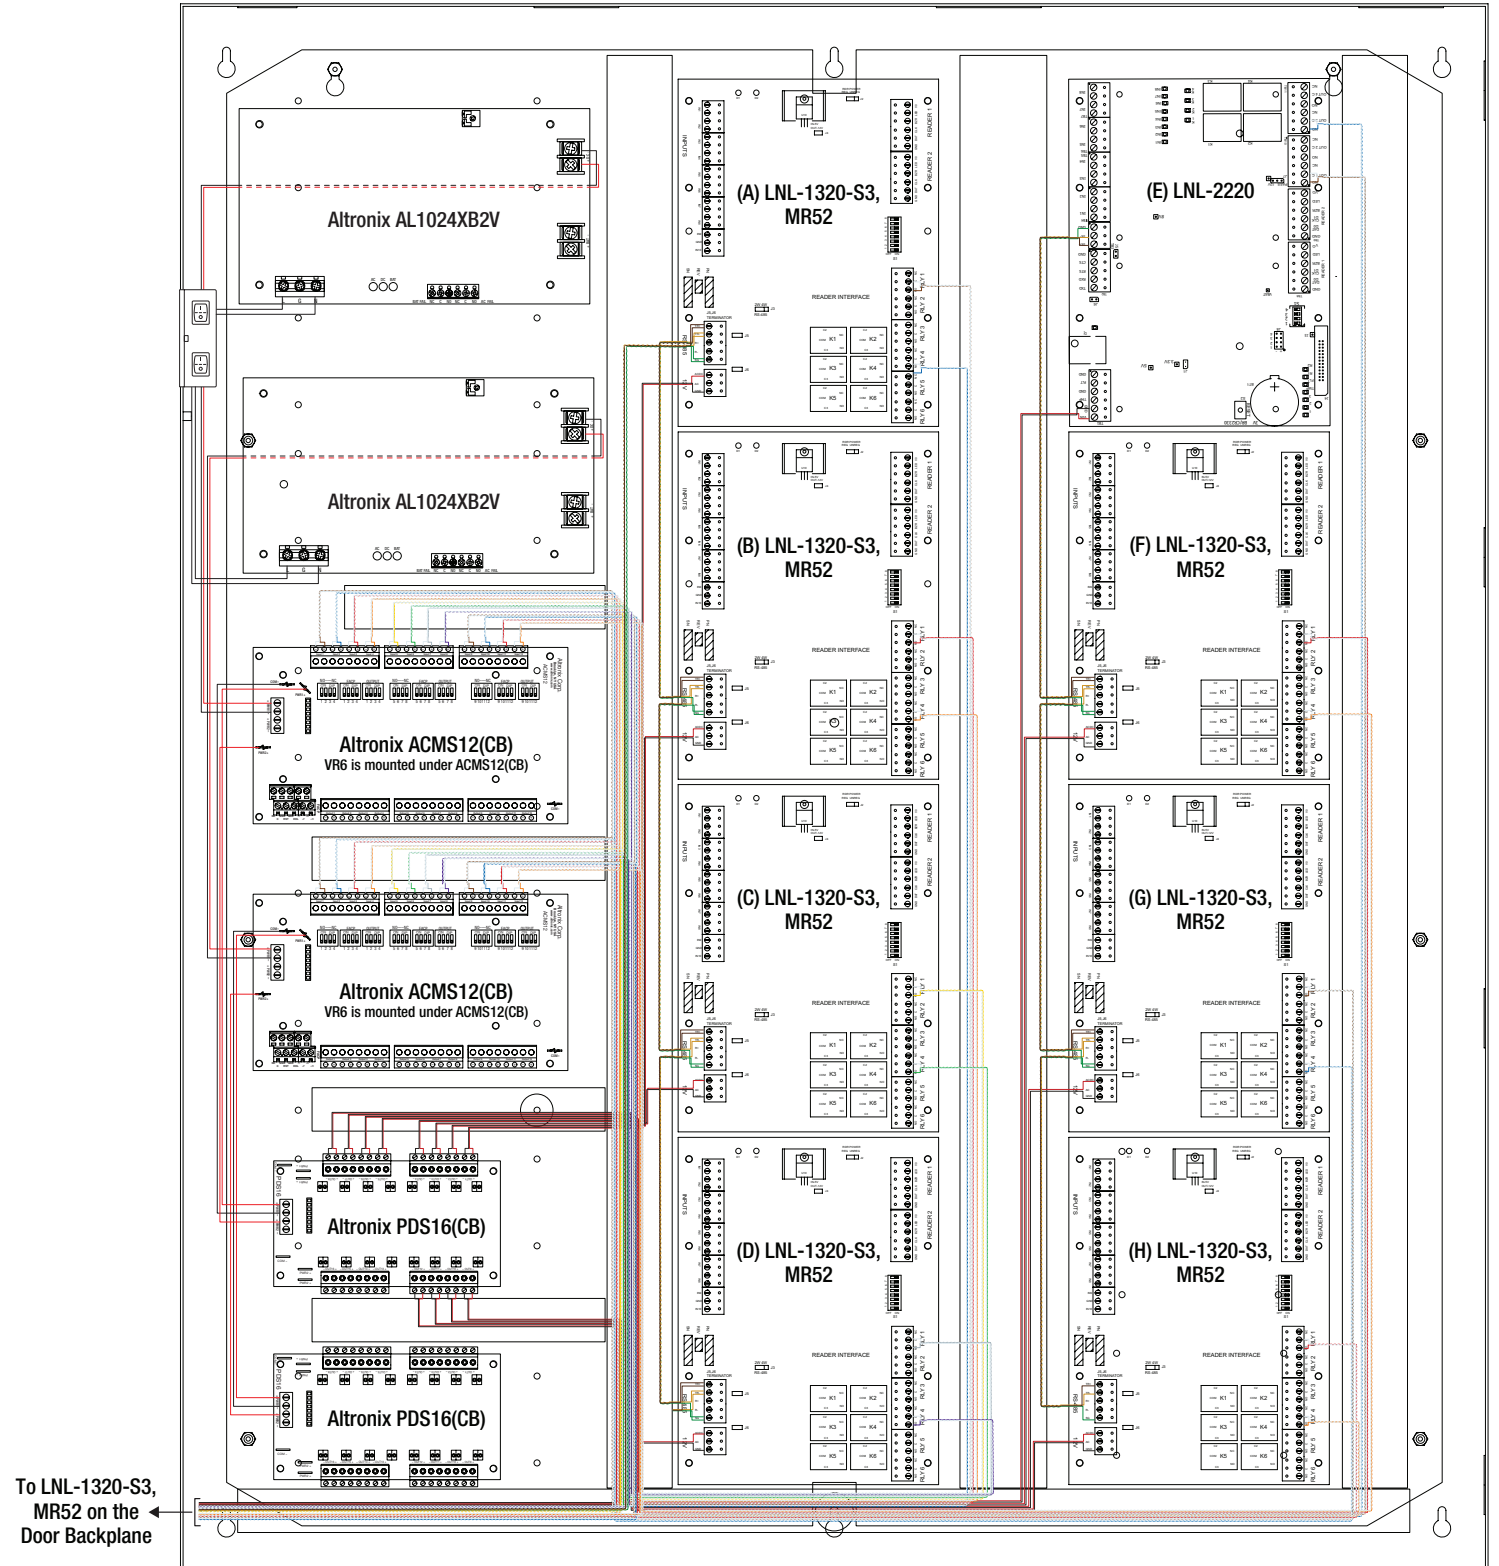


## T3M7724LXK1(D)V Door Backplane Configuration:

1. Position access controller module over corresponding spacers and depress onto snap on spacers (Fig. 3 pg. 4).
2. Mount backplane to enclosure with hardware.

### Access Controller Position Chart for the Following Models:

|                                     |                 |
|-------------------------------------|-----------------|
| LenelS2 / Mercury Access Controller | Pem Mounting    |
| LNL-1320-S3 / MR52                  | (I) (J) (K) (L) |

Fig. 3

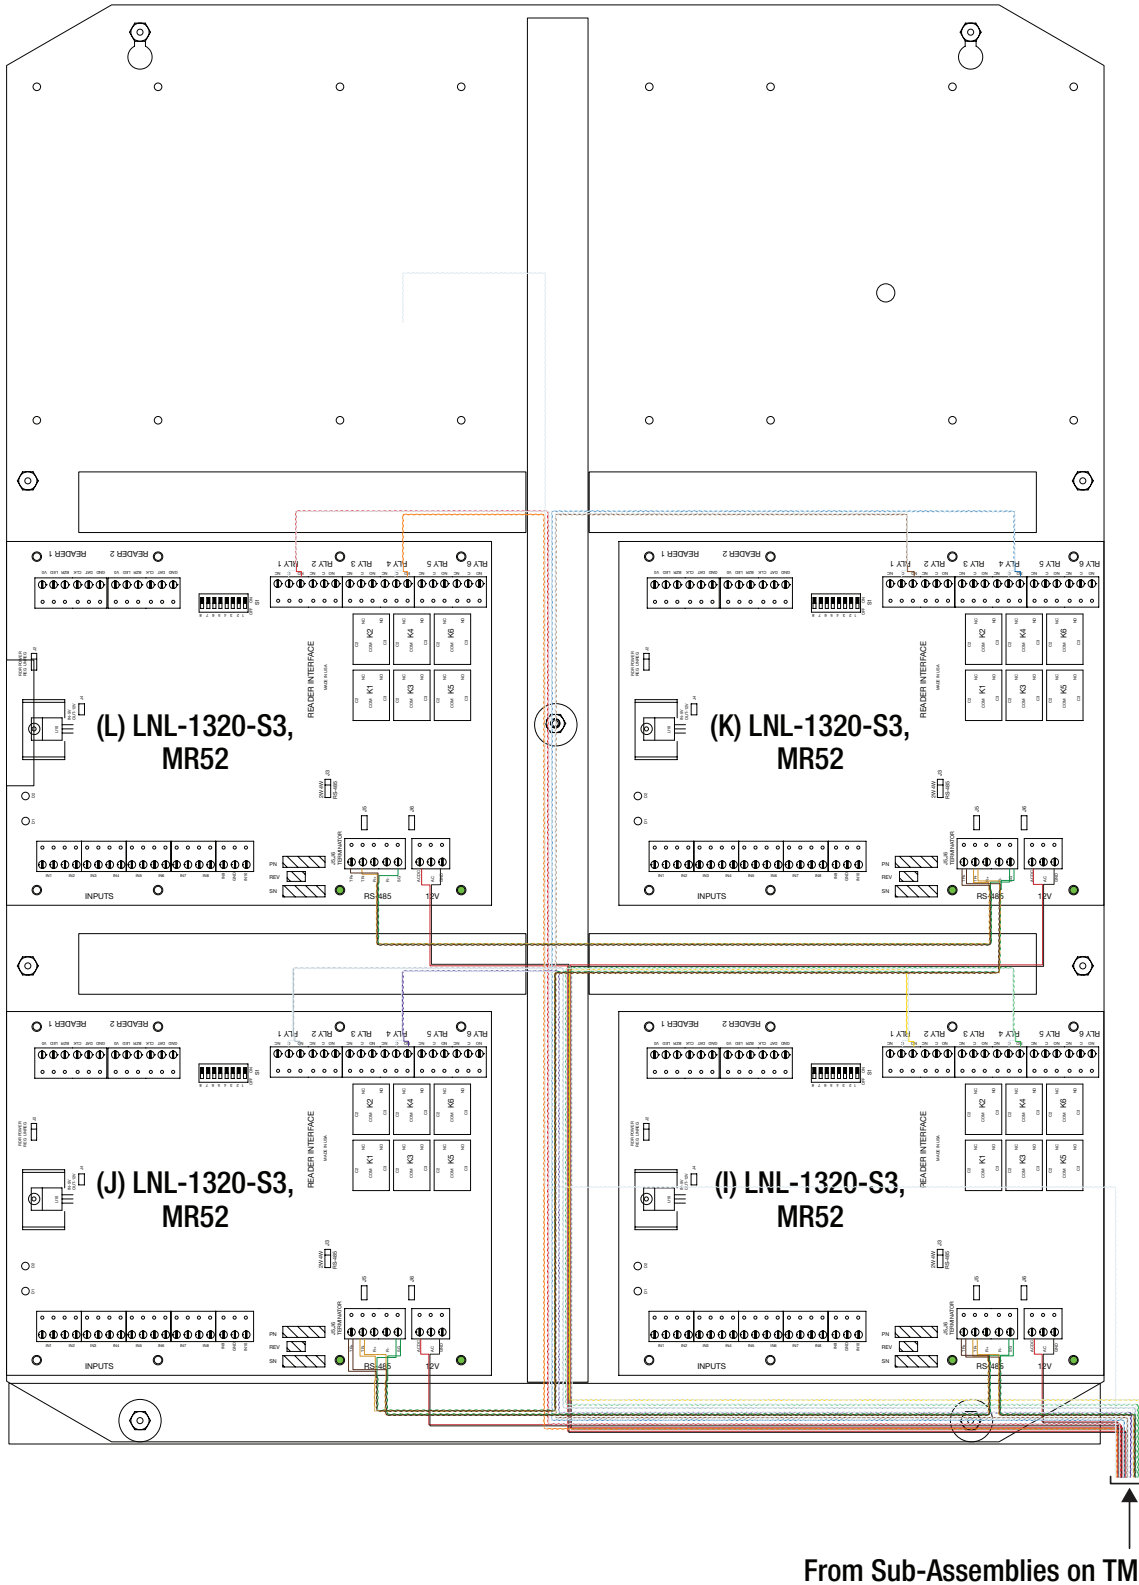


## Notes:

## Notes:

## Notes:

## Trove3 Enclosure Dimensions (H x W x D approximate):

36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm)

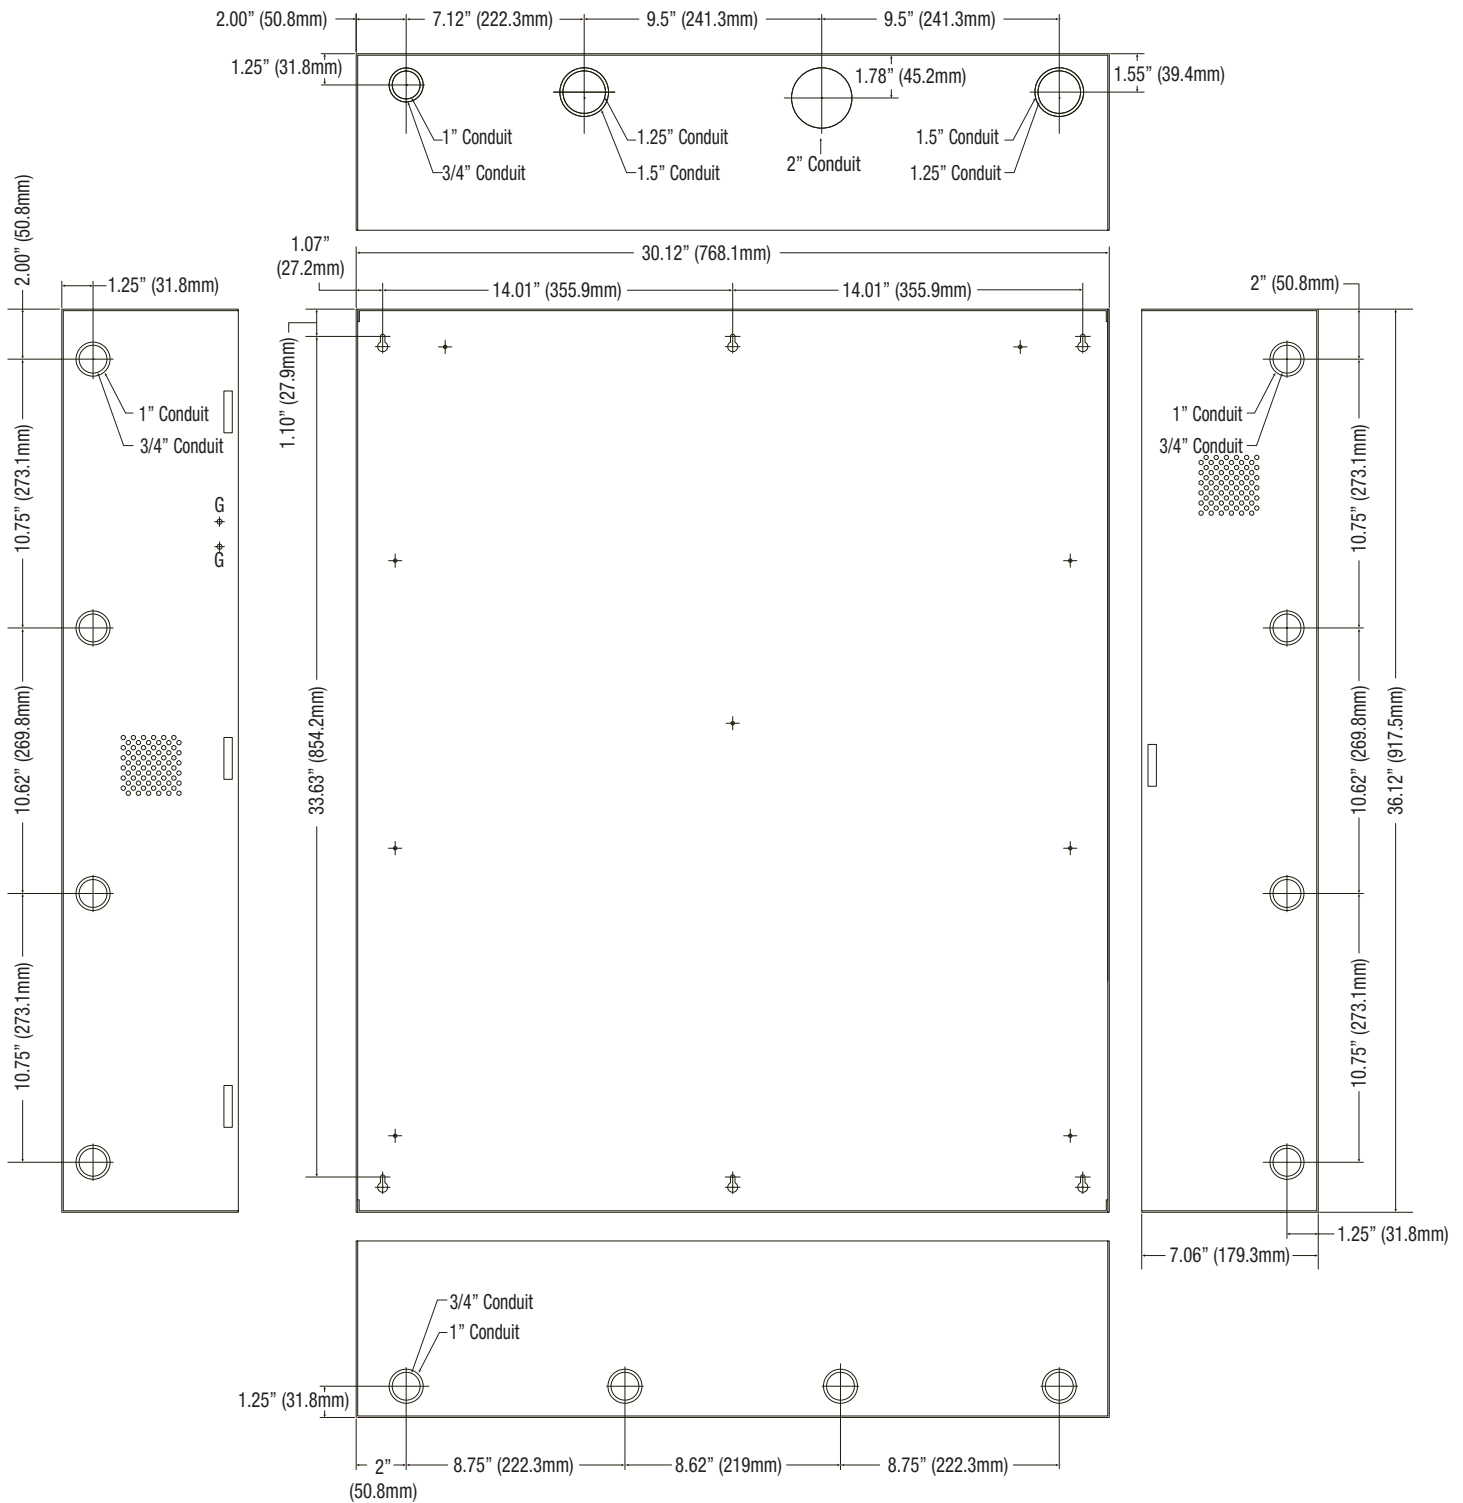

Altronix is not responsible for any typographical errors.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056  
 web site: [www.altronix.com](http://www.altronix.com) | e-mail: [info@altronix.com](mailto:info@altronix.com) | Lifetime Warranty  
 IIT3M7724LXK1(D)V

L27V

